
**MODA HEALTH – PARKING REVISIONS
TYPE III DOWNTOWN DESIGN REVIEW AND
WILLAMETTE RIVER GREENWAY REVIEW**

City of Milwaukie, Oregon

Prepared for

MODA Health

Prepared by

Otak, Inc.



HanmiGlobal Partner

April 11, 2014

(April 25, 2014 Resubmittal)

Project No. 17134

PROPOSAL SUMMARY

REQUEST: Type III Downtown Design Review, Parking Determination, and Willamette River Greenway Conditional Use review approval are requested for the plans for Moda Health to modify and expand the existing western parking lot at their office building by 30 parking spaces.

The western parking lot currently has 150 parking spaces. Another 56 spaces are located in the facility's eastern parking lot which is located between the building and SE 17th Avenue. The proposed revisions and expansion to the western parking lot would result in a total of 180 parking spaces in the western lot, and a total of 236 parking spaces overall.

A Parking Quantity Modification to the maximum allowed parking standard of Milwaukie Zoning Ordinance (MZO) 19.600 Table 19.605.1 is requested to allow the existing Moda Health operations to be served with parking at a maximum 3.6 parking spaces per 1,000 square feet of office building ratio instead of the normal Code allowed maximum ratio of 3.4 spaces per 1,000 square feet.

LOCATION: 10505 SE 17th Avenue. SE Lava Drive is immediately north of the site. Tax lot 3500 of Clackamas County assessors map, T1S R1E WM 35AA

ZONING: Downtown Office (DO) zone
Willamette River Greenway overlay zone (a portion of the site, only)
Natural Resource overlay zone (a portion of the site, only)

APPLICANT: Moda Health
601 SW 2nd Avenue
Portland, OR 97204-3156

Contact: David Shaffer
(503) 948-5564
david.shaffer@Modahealth.com

OWNER: Same

**ARCHITECT/
PLANNER:** Otak, Inc.
808 SW Third Avenue, Suite 300
Portland, OR 97204

Contact: Jerry Offer
(503) 415-2330
jerry.offer@otak.com

TABLE OF CONTENTS

I.	PROJECT DESCRIPTION	5
II.	EXISTING CONDITIONS	6
III.	COMPLIANCE with APPLICABLE APPROVAL CRITERIA.....	6
	A. Compliance with Development Standards of Downtown Zones - Chapter 19.304	6
	B. Compliance with Section 19.600 - Parking.....	7
	C. Compliance with Chapter 19.500 Supplementary Development Regulations.....	13
	D. Compliance with Chapter 19.401 Willamette Greenway Zone.....	13
IV.	CONSISTENCY with APPLICABLE DOWNTOWN DESIGN GUIDELINES.....	18
V.	CONCLUSION	19
VI.	APPENDICES	
	A. Pre-application	
	B. Conference Notes	
	C. City of Milwaukie Notice of Decision – Casefile MU-00-01	
	D. Application forms	
	E. Parking area lights cut sheet	
	F. Existing bicycle parking - photos	
	G. Storm drainage report	
VII.	REDUCED SIZE PLANS	
	Sheet P0.0 – Cover Sheet/Vicinity Map	
	Sheet P1.0 – Existing Conditions (with Tree Survey and Aerial Photo)	
	Sheet P1.1 – Overall Moda Health Site Plan/Aerial photo	
	Sheet P1.2 – Western Parking Lot Site Plan (shows Greenway and Natural Resource overlay zone boundaries)	
	Sheet P2.0 – Site Grading and Tree Removal Plan	
	Sheet L1.0 – Landscape Plan – Western Parking Area	
	Sheet L1.1 – Planting Notes and Details	

10 copies of the plan set have also been submitted in a larger plan format.

I. PROJECT DESCRIPTION

Moda Health requests Type III Downtown Design Review and Willamette River Greenway Conditional Use review approval to redevelop and expand the existing western parking lot at their offices located on SE Lava Drive. The parking lot is located west of the MODA Health building, south of SE Lava Drive, and east of SE Riverway Lane. A portion of the proposed parking lot expansion area is on a portion of the Moda Health site which is zoned with the Willamette Greenway overlay zone.

Currently, the existing eastern and western parking lots at the Moda Health offices include a total of 206 parking spaces. The eastern lot, which is located between the building and SE 17th Avenue, provides 56 parking spaces. The western parking lot includes 150 parking spaces. Moda Health would like to restripe portions of the western parking lot and expand it southward to increase the parking in that lot to 180 parking spaces, or a total of 236 parking spaces on the site.

In order to accomplish this, Moda Health requests approval of a Parking Quantity Modification to the maximum allowed parking standard which allows a maximum of 3.4 parking spaces for every 1,000 square feet of office use. That standard would typically allow a maximum of 199 parking spaces for the 58,529 square feet of office facilities within the MODA Health offices building. The provisions of Section 605.3.A. allows fleet parking spaces and designated carpool parking spaces to be exempted from the calculation of total parking count which is subject to the maximum onsite parking standard. Utilizing those exemptions, there would be a total of 206 parking spaces that would be subject to the maximum parking standard (236 total parking spaces – 2 fleet parking spaces – 24 carpool spaces = 210 parking spaces). Based upon that number, there would be 3.52 parking spaces for every 1,000 square feet of building area – which is excess of the maximum allowed parking standard. Zoning Code Section 605.2 allows the decision-making body to approve modifications to the minimum and maximum parking ratio standards subject criteria included within that section.

Expansion of the western parking lot would encroach 2,646 square feet into the approximately 62,5981 square feet of the designated Natural Resource overlay zone area on the site, and will require the removal of two regulated trees (trees of 6-inches or more caliper dbh) and four relatively young landscape trees. Type I Natural Resource District review will be requested separately to allow for the proposed encroachment into this area, and to specify mitigation planting measures to compensate for that encroachment.

It is anticipated that the proposed parking lot construction will occur in summer 2014.

Sheet P0.0 illustrates the location of the site. Sheet P1.0, Existing Conditions, illustrates the existing site improvements as well as the location, types, and sizes of mature trees. Sheets P2.0 through L1.1 illustrate the proposed development plan.

II. EXISTING CONDITIONS/PROJECT HISTORY

The 8.23-acre site is bounded by SE 17th Avenue on the east, SE Lava Drive on the north, and SE Riverway Lane, a private street, on the west. Johnson Creek is located to the south. The site is tax lot 3500 of Clackamas County Assessors map 1S 1E 35AA.

The site is developed with the two-story, 58,529 square foot MODA Health building, two associated parking lots, and substantial site landscaping. In addition, a wooded area to the south of the western parking lot provides a buffer between the uses on parcel I and single-family homes to the south. A portion of the site is located on the east side of Johnson Creek which passes through the site.

Establishment of Moda Health's health insurance office use of the site was approved by the City of Milwaukie Planning Commission on April 11, 2000 through Casefile MU-00-01 (see Appendix B for a copy of the notice of decision). Moda Health (formerly ODS, i.e., Oregon Dental Service) redeveloped the vacant former Pendleton Woolen Mills industrial building into an office building. The project involved substantial remodeling and three small expansions of the building.

III. COMPLIANCE WITH APPLICABLE APPROVAL CRITERIA OF TITLE 19 – THE MILWAUKIE ZONING ORDINANCE (MZO)

A. Compliance with Development Standards of the Downtown Zones - Chapter 19.304

The subject site is zoned Downtown Office (DO). The purpose of the Downtown Office district is to provide for office, entertainment, and hotel uses along high visibility major arterial streets, according to MZO Section 19-304.A.C. Table 19.304.3 lists primary uses which are intended to be allowed in the DO. Offices, professional and administrative are listed as a permitted use in the DO district. Moda Health's existing insurance administrative office use of the site is therefore consistent with the primary use standards of the DO zoning district. Section 19-304.E allows uses that are accessory to a primary use if they comply with the development standards. The onsite parking areas serving the Moda Health professional office use are an accessory use to the primary office use on the site, and therefore are permitted.

Section 19-304.4 provides a table of Development Standards in the Downtown Zones. None of these standards is applicable to the proposed parking area expansion, but instead apply to buildings on the site (e.g., floor area ratio, building setbacks, min./max. building height, ground floor use and development standards) or apply to the creation of new parcels (min. lot size and frontage). Compliance of the existing Moda Health building with any of these standards is not affected by the proposed parking lot expansion. Therefore, these standards are not addressed in this report. The Design Standards of Section 19-304.6 also relate only to buildings, and therefore do not apply to the proposal to expand the parking area at Moda Health.

B. Compliance with Section 19.600 - Parking

Sheet P1.2, the Western Parking Lot Plan, illustrates the proposed revisions to the western parking area including provisions for lighting, landscaping, walkways, and the parking lot layout. Sheet P1.1 provides an overall site plan.

Minimum/maximum parking space standards

MZO Section 19.605.1 provides minimum and maximum parking space standards for various uses. These standards are based upon either square footage of individual uses or number of employees. The existing Moda Health office is 58,529 square feet in area and is occupied by an administrative office use. Table 19.605.1 requires a minimum of 2 parking spaces per every 1,000 feet of gross floor space for office uses. Therefore, a minimum of 117 parking spaces are required. The proposed revised site plan provides for 236 parking spaces, thereby exceeding the minimum number of parking spaces that are required.

Table 19.605.1 allows a maximum 3.4 parking spaces for every 1,000 square feet of gross floor area for an office use. At that ratio, the 58,529 square feet of building area occupied by Moda Health would be allowed 199 parking spaces. The total parking area proposed will provide for 236 parking spaces, or 4.03 parking spaces for every 1,000 square feet of gross floor area in the office building – prior to allowed exemptions of certain categories of parking spaces.

Twenty-four of the parking spaces will be reserved for employee carpool vehicles and can be exempted from this calculation, per Section 19.605.3.A.4. Three of the parking spaces will be reserved for MODA fleet vehicles and can be exempted from this calculation, per Section 19.605.3.A.5. Utilizing those exemptions, there would be a total of 209 parking spaces that would be subject to the maximum parking standard (236 total parking spaces -24 carpool spaces -3 fleet parking spaces = 209 parking spaces). Based upon that number, there would be 3.57 parking spaces for every 1,000 square feet of building area – which is still in excess of the maximum allowed parking standard. Zoning Code Section 605.2 allows the decision-making body to approve modifications to the minimum and maximum parking ratio standards subject criteria included within that section. It is requested that the Planning Commission approve a Parking Quantity Modification to the maximum allowed parking space standard for the Moda Health project to instead allow a rounded up maximum ratio of 3.6 parking spaces per 1,000 square feet of office area, as will be discussed in the following paragraphs.

MZO subsection 19.605.2 allows for the modification of minimum and maximum parking ratios from Table 19.605.1 as well as the determination of minimum and maximum parking requirements. This subsection says that parking determinations shall be made when the proposed use is not listed in Table 19.605.1 and for developments with large parking demands. In this case, Moda Health has found that their operations are rather labor intensive with a large parking demand. Currently, the Moda Health Milwaukie facility has 236 occupied work stations plus 9 other employees, which totals 245 employees at the building at the current employment level. In addition, the facility may have visitors such as clients, vendors, building machine repair personnel, and meeting visitors from Moda Health's Portland office. Together,

those numbers of employees and visitors can cause the existing Moda Health parking lots to be filled to capacity, and for some visitors or employees to park on SE Lava Drive. In response to neighbors concerns, the City of Milwaukie has recently decided to post SE Lava Drive as a “no parking” area. In addition to the intensive use of the building and its parking lots, Moda Health plans on expanding employment at their Milwaukie facility to occupy all of the existing work stations at the facility and to increase the number of total employees to 281 at the Moda Health Milwaukie facility. Based upon the current parking lots currently often being filled to capacity; the planned removal of on-street parking on SE Lava Drive; and Moda Health’s plans to expand employment at this facility to fully utilize the existing available work stations, Moda Health requests a Parking Quantity Modification to the maximum allowed parking standard for office uses.

MZO subsection 19.605.2.B says that the determination of a modification to a minimum or maximum parking standard should be based upon the following factors (with response provided):

1. *Describe the proposed uses of the site, including information about the size and types of the uses on site, and information about site users (employees, customers, etc.).*

Response: Moda Health currently employs approximately 245 employees on a typical daytime shift at their Milwaukie office building. Moda Health utilizes flex-time scheduling with employees arriving at times between 7:30 AM and noon. Moda Health is planning on adding another 36 employees to occupy existing work stations at the Moda Health Milwaukie facility. On a typical day, Moda health anticipates that another 20 to 25 visitors may be at their facility for meetings; to make sales calls on Moda; to service office machines; and to take care of their business with Moda Health. All of these employees and visitors create a substantial demand for onsite parking beyond what is normally allowed by the City of Milwaukie’s maximum allowed parking standard. This significant parking demand often fills the existing parking lot and leads to on-street parking on SE Lava Drive. In reaction to neighbors’ complaints, the City of Milwaukie has recently decided to post SE Lava Drive adjacent to the Moda Health facility as a no parking area. This will also undoubtedly lead to an increase in the demand for onsite parking.

2. *Identify factors specific to the proposed use and/ or site, such as the proximity of transit, parking demand management programs, availability of shared parking, and/ or special characteristics of the customer, client, employee or resident population that affect parking demand.*

Response: The Moda Health Milwaukie site is relatively well served by public transit. TriMet Bus route 70 has a stop on SE 17th Avenue right in front of Moda Health’s eastern parking lot and a north-bound stop across the street. Moda Health provided for the installation of bus waiting shelters at these stops as part of their original improvements related to moving onto the former Pendleton Woolen mills site. In addition, the TriMet Milwaukie transit center, which is located approximately 1,500 feet away on SE Jackson Street, is served by routes 28, 29, 30, 31, 32, 33, 34, 70, 75, 99, and 152. Routes 31, 32, and 33

make stops on SE Main Street approximately 1,500 feet from the primary Moda Health facility entrance.

Moda Health already provides transit pass subsidies for employees, provides transit information, provides carpool parking, and provides sufficient bicycle parking spaces and amenities – including indoor bike parking spaces along with lockers and employee showers. Moda Health encourages employees to use alternative means of transportation other than single-occupant vehicles through a monthly prize drawing for users of alternative means of transportation. Even with the relatively good transit service available to the site and the transit subsidies and other measures, Moda Health still finds that enough employees drive to work such that the current demand for onsite parking exceeds the current supply, and is anticipated to be further exceeded when employees are added.

3. *Provide data and analysis specified in Subsection 19.605.2.B.3 to support the determination request. The Planning Director may waive requirements of Subsection 19.605.2.B.3 if the information is not readily available or relevant, so long as sufficient documentation is provided to support the determination request.*

a. *Analyze parking demand information from professional literature that is pertinent to the proposed development. Such information may include data or literature from the Institute of Transportation Engineers, American Planning Association, Urban Land Institute, or other similar organizations.*

b. *Review parking standards for the proposed use or similar uses found in parking regulations from other jurisdictions.*

c. *Present parking quantity and parking use data from existing developments that are similar to the proposed development. The information about the existing development and its parking demand shall include enough detail to evaluate similarities and differences between the existing development and the proposed development.*

Response: A quick review of available studies related to maximum parking demand for offices uses in professional literature found nothing really on-point for this specific type of use. There is plenty of discussion on the topic of maximum parking standards in professional literature, but it primarily showed that maximum allowed parking standards vary greatly nationwide to the point of not being usable in the current case. Instead, we would like to point out that other jurisdictions in the Portland Metropolitan area have greater maximum parking standards for office uses than does the City of Milwaukie, while the Clackamas County Zoning Ordinance allows a maximum parking standard of 3.4 per 1,000 square feet of office area within parking zone A (which has 20-minute peak hour transit service within one-quarter mile walking distance for bus transit or one-half mile walking distance for light rail transit. 20-minute peak hour transit service is available on several Tri Met routes to/from the Milwaukie Transit Center, but only route 70 provides 20-minute peak hour transit service within one-quarter mile of the site. The Milwaukie Transit Center is more than one-quarter mile from the Moda Health offices. Clackamas County allows a maximum of 4.1 parking spaces per 1,000 square feet for offices beyond a one-quarter mile distance from peak transit service. Washington County and the Cities of

Gladstone and Beaverton have identical maximum parking standards to Clackamas County's. The City of Happy Valley does not have a maximum parking standard which applies to office developments. The City of Portland has a more stringent maximum parking standard for office uses.

4. *Propose a minimum and maximum parking ratio. For phased projects, and for projects where the tenant mix is unknown or subject to change, the applicant may propose a range (low and high number of parking spaces) for each development phase and both a minimum and maximum number of parking spaces to be provided at buildout of the project.*

Response: Because of the intensive employee and visitor use of the Moda Health parking facilities, it is requested that the City consider allowing a maximum parking standard for the employee intensive office use of Moda Health of 3.6 parking spaces per 1,000 square feet of office space.

5. *Address the approval criteria in Subsection 19.605.2.C. [cited below]*

C. *Approval Criteria*

The Planning Director shall consider the following criteria in deciding whether to approve the determination or modification. The Planning Director, based on the applicant's materials and other data the Planning Director deems relevant, shall set the minimum parking requirement and maximum parking allowed. Conditions of approval may be placed on the decision to ensure compliance with the parking determination.

1. *All modifications and determinations must demonstrate that the proposed parking quantities are reasonable based on existing parking demand for similar use in other locations; parking quantity requirements for the use in other jurisdictions; and professional literature about the parking demands of the proposed use.*

Response: As noted above, Moda Health requests that the City of Milwaukie apply a maximum parking standard for their use of 3.6 parking spaces per 1,000 square feet. As described above, a maximum 3.6 per 1,000 square feet ratio would be less than Clackamas County's, Washington County's, Gladstone's and Beaverton's maximum parking standards for areas which are not served by high frequency peak period transit. The requested 3.6 per 1,000 ratio would be slightly greater than Milwaukie's current maximum parking space ratio as well as other jurisdiction's maximum allowed parking ratios for sites which are well served by transit. However, the Moda Health site is served by just one high frequency peak transit period transit route making this case different than other situations where the facilities subject to a more stringent standard really are served by high frequency transit service.

2. *In addition to the criteria in Subsection 19.605.2.C.1, requests for modifications to decrease the amount of minimum required parking shall meet the following criteria:*

Response: The current request is a request to increase the maximum allowed parking standard, not decrease the minimum. Therefore, this subsection does not apply.

3. *In addition to the criteria in Subsection 19.605.2.C.1, requests for modifications to increase the amount of maximum allowed parking shall meet the following criteria:*
 - a. *The proposed development has unique or unusual characteristics that create a higher-than-typical parking demand.*
 - b. *The parking demand cannot be accommodated by shared or joint parking arrangements or by increasing the supply of spaces that are exempt from the maximum amount of parking allowed under Subsection 19.605.3.A.*
 - c. *The requested increase is the smallest increase needed based on the specific circumstances of the use and/or site.*

Response: The text above has demonstrated that Moda Health has a very high employee per 1,000 square feet ratio of 4.19 employees per 1,000 square feet and a significant number of site visitors – all of whom pose a significant parking demand. In addition, Moda Health plans to add employees to utilize existing work stations to increase that ratio to slightly over 4.8 employees per 1,000 square feet. This high employee per 1,000 square foot ratio helps create a higher than typical parking demand for an office use, thereby helping justify the need for relief from the current maximum parking standard.

Moda Health has already instituted a transit subsidy plan, provides transit information to employees, and provides preferred carpool, motorcycle and bicycle parking. Moda Health is committed to continuing to encourage carpooling and the use of alternative means of transportation. Moda Health has committed to provide 24 parking spaces as reserved carpool spaces as part of the current plans to expand their western parking lot. This represents 10 percent of the total number of parking spaces on the site – a very high ratio. (The reserved carpool spaces have been exempted from the parking which is subject to the maximum parking ratio standard.) In summary, Moda Health is already encouraging the use of alternatives to employees utilizing their personal vehicles for commuting purposes.

Moda Health has explored the possibility of a long-term shared parking agreement, but there are no conveniently located parking areas available. Although the Moda Health offices are located just about 650 feet across SE McLoughlin Boulevard from the Kellogg Bowl bowling facility as the crow flies (or as a pedestrian jaywalks), the lineal distance on public street sidewalks between the Kellogg Bowl and Moda Health is approximately 2,000 lineal feet using sidewalks and marked crosswalks across SE McLoughlin Boulevard and SE 17th Avenue. For the reason of distance alone, it is not practical for Moda Health to seek to enter into a long-term offsite parking agreement with the only nearby parking lot which would appear to have excess capacity during normal office hours. Additionally, it is believed that this distance would be too great

for long-term use by Moda Health employees to use over the long term (especially in winter) if no additional on-site parking spaces are developed. There are no other closer parking facilities which would appear to be relatively unused during daytime hours which might be available for a shared parking agreement.

The requested modification to the maximum allowed parking standard to allow a 3.6 spaces per 1,000 square foot standard would permit Moda Health to provide 210 non-exempt parking spaces for its 58,529 square foot facility. The requested increased ratio is the smallest increase needed based on the specific circumstances of Moda's use and the constraints of the site.

Parking lot design standards

Seven disabled person parking spaces will be provided in the east and west parking lots in locations convenient to main building entrances. The number of disabled person spaces is consistent with the Uniform Building Code standards and thus is also consistent with Section 503.10.

The parking lot is designed consistent with the dimensional standards specified and illustrated by MZO Section 19.606. Minimum parking lot aisle widths are consistent with the 22-foot minimum width standard so as to assure adequate emergency vehicle access throughout the site. All exterior portions of the existing building will be located within 150 feet of an accessway accessible to emergency vehicles. Parking areas will be constructed of asphaltic concrete in accordance with the standards of Section 19.606.3.A.

Loading

MZO Section 19.608.2 requires that two loading spaces be provided for non-residential uses of over 50,000 square feet. The Moda Health building is 58,529 square feet in size. Two 30 by 12 foot wide existing loading spaces are provided consistent with this standard. The loading spaces are adequately sized for the type of delivery vehicles that typically visit the Moda Health facility. The loading spaces are located so as not to interfere with parking lot aisles and are located distant from the site's boundaries.

Section 19.609 sets standards for required bicycle parking for commercial uses. Section 19.609.2.A.1 requires that bicycle parking spaces be provided in a number that is at least 10 percent of the number of automobile parking spaces which are required for the use. In this case, 117 vehicle parking spaces are required; therefore, a minimum of 12 bicycle parking spaces are required. The existing site improvements provide for 29 bicycle parking spaces, thereby satisfying this requirement. Five bicycle parking spaces are located in a bicycle rack located outside adjacent to the building's southern entrance, with 24 bicycle parking spaces located inside the building just inside that entrance. Lockers and employee shower facilities are provided. Existing bicycle parking facilities are illustrated on the site plan. Photos of the existing facilities are include in Appendix E.

Six carpool spaces are currently provided at the Moda Health facility. The carpool spaces will be increased to 24 parking spaces or 20% of the minimum required parking spaces provided. This amount of carpool space will exceed the requirement of Section 19.610.2 that a minimum of 10 percent of the required parking spaces in a commercial development be designated as carpool/van pool parking spaces. Consistent with Section 19.610.3, the designated carpool/vanpool parking spaces are conveniently located near main entrances to the building. Carpool spaces will be clearly designated by either pavement markings or signs as required.

C. Compliance with Chapter 19.500 Supplementary Development Regulations

The standards of MZO Chapter 19.500 were reviewed. There do not appear to be any standards from this chapter which would apply to the proposed parking lot expansion project. It is pointed out that the Transition Area measures prescribed by Section 19.504.6 where commercial or industrial uses are located adjacent to properties zoned for low density residential use do not apply within the downtown area zones, as specifically called out by that Section. The properties to the west of the site across SE Riverway Lane are zoned R2 which is classified as a medium and high density zone by Table 19.302.2 of the MZO. Therefore, these neighboring properties are not low density zones which would require the imposition of the Transition Area standard. Nevertheless, an attempt has been made to provide a sufficient buffer of landscaping and existing trees between the parking area's boundary with SE Riverway Lane and the properties across the street – some of which are developed with low density uses even if they are not zoned that way.

D. Compliance with Chapter 19.401 Willamette Greenway Zone

A portion of the site is designated with the Willamette Greenway (WG) overlay zone, including all of the area proposed for expansion of the western parking lot. The boundary of the Willamette Greenway overlay zone is illustrated on the site plans. The general purpose of the Greenway overlay zone is to protect, conserve, enhance and maintain the natural, scenic, historic, economic, and recreational qualities of lands along the Willamette River and its tributaries according to MZO Section 19.401.

Section 19.401.3 states that changes or intensifications of use, or development permitted in the underlying zone are conditional uses subject to Section 19.905. Although the existing Moda Health building is not located within the Greenway zoned portion of the site, the western parking lot and areas where additional landscaping are to be placed are located within the Greenway zone. To the extent that these activities are a change of use or development, Greenway conditional use approval is required. The proposed parking lot expansion within the Willamette Greenway overlay zone is not one of the prohibited uses listed in Section 19.401.3.

The general approval criteria for a conditional use are found in Section 19.905.4. Since the proposed parking lot expansion into the area of the site covered by the Willamette River Greenway is substantially larger than currently exists with the existing parking areas, we are assuming that the City will treat this as a major modification to an existing conditional use

rather than as a minor modification. As such, we have addressed the approval criteria for a major modification of Section 19.905.4.A. The criteria are cited below in *italics* with a response following each criteria:

1. *The characteristics of the site are suitable for the proposed use considering size, shape, location, topography, existence of improvements and natural features.*

Response: The Greenway zoned portion of the site which is proposed to be utilized for parking, a walkway, and landscaping is already used for those sorts of improvements. These areas within the Greenway zone are located outside of the banks of Johnson Creek and are in areas which do not have existing natural vegetation, steep slopes, or other characteristics which might make these areas inappropriate for the sorts of improvements which are proposed.

2. *The operating and physical characteristics of the proposed use will be reasonably compatible with, and have minimal impact on, nearby uses.*
3. *All identified impacts will be mitigated to the extent practicable.*

Response: The proposed parking area will take its access from the existing parking area driveway from SE Lava Drive. As such, traffic related to the expanded parking area should not be anticipated to have much in the way of impacts upon nearby uses – especially the single-family uses on SE Riverview. Storm drainage from the expanded parking lot will be collected in stormwater catch basins with storm filter type treatment equipment, piped under the parking area, and then being discharged to the tree covered slope above Johnson Creek, and then flowing to the Creek. Tree removal will be minimized so that only three existing mature trees will be removed.

The proposed Landscaping Plan, Sheet L1.0, proposes the addition of 18 trees within and adjacent to the parking area to mitigate for the loss of two mature trees and four parking area trees which were planted within the past 14 years. In addition, a hedge of native shrubs will be planted along the southern and western edges of the area of proposed parking lot expansion to provide low level screening of the expanded parking area from views from neighboring properties, and (remotely) possibly from the river. The proposed additional landscaping should also provide additional wildlife habitat and cover to mitigate for the existing plants and trees to be removed.

As such, the operating characteristics of the proposed expanded parking lot use within the greenway area will have minimal impacts upon nearby uses; such impacts will be mitigated to the extent practicable by landscaping, stormwater collection and treatment measures, and by landscaping providing a buffer between the parking lot and adjacent uses. No potential impacts upon the Willamette greenway uses or values have been identified.

4. *The proposed use will not have unmitigated nuisance impacts, such as from noise, odor, or vibrations greater than uses allowed outright at the proposed location.*

Response: No nuisance impacts have been identified related to the proposed expanded parking lot use.

5. *The proposed use will comply with all applicable development standards and requirements of the base zone, any overlay zones or special areas and the standards in Section 19.905.*

Response: The existing administrative office use of the site is a permitted use in the underlying DO zone applied to the site, as addressed elsewhere in this report. The proposed parking area expansion would be considered as accessory to the primary office use. This application narrative addresses the applicable development standards and requirements of the base DO zone, the Willamette Greenway and Natural Resource overlay zones, and this section addresses the requirements of Section 19.905.

6. *The proposed use is consistent with applicable policies of the Comprehensive Plan related to the proposed use.*

Response: The Comprehensive Plan was reviewed for any Plan policies applicable to the proposed expanded parking lot use within the Willamette Greenway of the site. No Objectives or Policies seem to really be on point with regard to the proposed parking lot expansion on an upland portion of the Willamette greenway zoned area. The Objectives and Policies of the Willamette Greenway element of the Comprehensive Plan primarily direct City actions to maintain the Greenway boundary, develop Zoning Ordinance permitting processes for activities within the Greenway, direct further Greenway planning by the City, and address public access and private property rights. Establishing that the proposed development is consistent with the Greenway Conditional Use approval criteria which implement the regulatory Plan policies is tantamount to satisfaction of the Comprehensive Plan goals and policies.

7. *Adequacy public transportation facilities and public facilities will be able to serve the proposed use prior to occupancy pursuant to Chapter 19.700.*

Response: The site is already well served by public roadways, transit service, and public utilities necessary to serve the proposed use. No additional transportation or public facilities will be necessary to serve the proposed parking area expansion

In addition to the general conditional use approval criteria of Section 19.905.4.A, the following criteria of Section 19.401.6 also apply to a proposal in the Willamette Greenway overlay zone:

- a. *Whether the land to be developed has been committed to an urban use, as defined under the State Willamette River Greenway Plan.*

Response: The area of the site within the greenway which is to be utilized under the proposed plan already includes a paved parking lot and landscaping which are associated with an existing urban type of building located elsewhere on the site, along with some wooded area. Therefore, the land is already committed to an urban use.

b. Compatibility with the scenic, natural, historic, economic, and recreational character of the River;

Response: The proposed parking lot expansion, addition of additional walkway, and the addition of vegetation as illustrated on the Landscape Plan, Sheet L1.0, should not have significant effects upon the scenic and natural characteristics of the river since the proposed parking lot expansion area will be separated from the river by existing single- and multi-family residential development and the improved SE Riverway Lane. The proposed parking lot expansion will remove two large trees whose tops may be visible from the river, but again, most of the trees' structure is currently not visible from the river because of the intervening homes and multi-family buildings. In addition, the majority of the existing trees on the Moda Health site will be retained so while views of the trees on the site may be altered slightly, views of the trees from the river will not be eliminated. [Note, it is noted that this Code provision echoes Comprehensive Plan, Willamette Greenway Element, Objective #5, Policy 5].

The proposed changes should not affect the historic or economic character of the Greenway or the river.

c. Protection of views both toward and away from the River; . [It is noted that this Code provision echoes Comprehensive Plan, Willamette Greenway Element, Objective #5, Policy 3].

and

d. Landscaping, aesthetic enhancement, open space, and vegetation between the activity and the River, to the maximum extent practicable;

Response: The proposed site improvements should have little if any effect upon views toward or from the river. As noted above, this area is physically and visually separated from the river by existing development and a road.

e. Public access to and along the River, to the greatest possible degree, by appropriate legal means;

Response: There is currently no public access to the river on the subject site, or on other nearby properties. No additional public access is proposed; nor will any existing public access be affected by the proposed parking area development.

f. Emphasis on water-oriented and recreational uses;

Response: The proposed parking area improvements within the Greenway area are intended to support a non-water oriented, non-recreational use in a building outside of the Greenway. [It is noted that this Code provision echoes Comprehensive Plan, Willamette Greenway Element, Objective #3, Policy 4].

g. Maintain or increase views between the Willamette River and downtown;

Response: The proposed lower elevation parking area related site improvements should have no effect upon views between downtown and the river.

h. Protection of the natural environment according to regulations in Section 19.402;

Response: Compliance with the requirements of the Natural Resource overlay zone, Section 19.402, is addressed below.

i. Advice and recommendation of the Design and Landmark Committee, as appropriate;

Response: No response is necessary at this time.

j. Conformance to applicable Comprehensive Plan policies;

Response: Compliance with Willamette Greenway related Plan policies is addressed within the responses to Section 19.401 is closely related to a Plan Policy. The entire plan was reviewed for policies which might impact the proposed parking lot expansion. All of the policies which were applicable have been cited within this application narrative.

k. The request is consistent with applicable plans and programs of the Division of State Lands;

Response: We are not aware of any plans or programs of the Division (now Department) of State Lands which would be affected by the proposed site improvements.

l. A vegetation buffer plan meeting the conditions of subsection 19.401.8A through C.

Response: Section 19.401.8.A provides that a buffer strip of vegetation shall be identified along the river, which shall include the land area between the river and a location 25 feet upland from the ordinary high water line and this section further requires that this area be preserved, enhanced or re-established. The subject parking area expansion is located far from the River and is separated from it by residential development and SE Riverview Lane.

Section 19.401.7 suggests that non water-related or water-dependent uses be directed away from the Willamette River. The proposed expanded parking area is non water-related and water-dependent, and will be appropriately be located away from the river.

IV. CONSISTENCY WITH APPLICABLE DOWNTOWN DESIGN GUIDELINES

The subject property is zoned with the Downtown Office zoning district. As such, the proposed parking lot expansion project has been determined to be subject to Downtown Design Review. It is noted that the subject site has not been included on the following plans from the Milwaukie Downtown Design Guidelines document: Fundamental Concepts Diagram; Storefront Main Street Area; and Amenities and Open Space Framework Map. The only map within the Guidelines which includes the subject site is a segment of the City of Milwaukie Zoning Map.

Below are responses to the applicability of the broad categories of Guidelines listed in the Milwaukie Downtown Design Guidelines document, with responses to specific guidelines which appear to be applicable to the current proposal.

Milwaukie Character Guidelines

The Milwaukie Character Guidelines were reviewed with regard to the proposed Moda Health parking lot expansion. None of these guidelines would appear to relate directly to this project. The only one which indirectly relates says *“Buildings should be “good neighbors.” They should be compatible with surroundings buildings by avoiding disruptive excesses. New buildings should not attempt to be the center of attention.”*

The proposed parking lot expansion does not involve the construction or renovation of a building. However, it does involve the expansion of an existing parking lot use within a developed neighborhood. The proposed expanded parking lot’s design is limited in scale in order to not stand out in the neighborhood and to be as compatible as possible with neighboring single-family and multi-family uses. Landscape materials to be used within and adjacent to the parking lot will not only screen views of the parking lot from neighboring uses, but will also add to the well landscaped character of the Moda Health project site and to the neighborhood.

Pedestrian Emphasis Guidelines

The Pedestrian Emphasis Guidelines were reviewed with regard to the proposed Moda Health parking lot expansion. None of these guidelines would appear to relate directly to this project, other than the following Guidelines:

Barriers to pedestrian movement and visual and other nuisances should be avoided or eliminated, so that the pedestrian is the priority in all development projects.

Accommodate handicap access in a manner that is integral to the building and public right-of-way and not merely designed to meet minimum building code standards.

The proposed parking lot expansion project includes an extension of the on-site pedestrian sidewalk so as to provide a convenient and safe paved pedestrian connection into the Moda Health building, including provisions for disabled person access ramps.

Architecture Guidelines

The Architecture Guidelines were reviewed with regard to the proposed Moda Health parking lot expansion. None of these guidelines would appear to relate directly to this project.

Lighting Guidelines

The Lighting Guidelines were reviewed with regard to the proposed Moda Health parking lot expansion. None of these guidelines would appear to relate directly to this project. The proposed parking lot project will involve adding a few parking lot lights of the same general type as are currently in use in the parking area. Parking lot light pole locations are illustrated on the Preliminary Landscape Plan, Sheet L1.0. A cut sheet for the new light fixtures is included in Appendix D.

Sign Guidelines

The Sign Guidelines were reviewed with regard to the proposed Moda Health parking lot expansion. None of these guidelines would appear to relate directly to this project. No additional signs will be placed on the site as part of the current parking lot expansion project.

V. CONCLUSION

This application narrative and the attached plans demonstrate that all applicable provisions of the City of Milwaukie Zoning Ordinance, Comprehensive Plan, and Downtown Design Guidelines are satisfied by the plans of Moda Health for the redevelopment of the Pendleton Woolen Mills property. Moda Health and Otak, Inc. therefore respectfully request approval of the requested Type III Downtown Design Review, Willamette River Greenway conditional use, and Parking Modification applications.


Appendix



Appendix A



HanmiGlobal Partner



April 17, 2014

Jerry Offer
OTAK, Inc.
808 SW Third Avenue, Suite 300
Portland, OR 97204

Re: Preapplication Report

Dear Jerry:

Enclosed is the Preapplication Report Summary from your meeting with the City on April 3, 2014, concerning your proposal for action on property located at 10505 SE 17th Avenue.

A preapplication conference is required prior to submittal of certain types of land use applications in the City of Milwaukie. Where a preapplication conference is required, please be advised of the following:

- Preapplication conferences are valid for a period of 2 years from the date of the conference. If a land use application or development permit has not been submitted within 2 years of the conference date, the Planning Director may require a new preapplication conference.
- If a development proposal is significantly modified after a preapplication conference occurs, the Planning Director may require a new preapplication conference.

If you have any questions concerning the content of this report, please contact the appropriate City staff.

Sincerely,

Blanca Marston
Administrative Specialist II

Enclosure

cc: Pete Miller, OTAK
David Shaffer, MODA
File

CITY OF MILWAUKIE

PreApp Project ID #: 14-005PA

PRE-APPLICATION CONFERENCE REPORT

This report is provided as a follow-up to a meeting that was held on 4/3/2014 at 10:00am

Applicant Name: Jerry Offer
Company: Otak, Inc.
Applicant 'Role': Other
Address Line 1: 808 SW 3rd Ave Ste 300
Address Line 2:
City, State Zip: Portland OR 97204
Project Name: MODA Parking Expansion
Description: Downtown Design Review and Natural Resource Review for adding parking to existing parking lot.
ProjectAddress: 10505 SE 17th Ave
Zone: Downtown Office (DO)
Occupancy Group: NA
ConstructionType: NA
Use: Town Center (TC), with the southeastern-most portion of the site designated as High Density (HD)
Occupant Load: NA
AppsPresent: Jerry Offer, David Shaffer, Peter Miller
Staff Attendance: Brett Kelter, Brad Albert, Philip Kolb, John Stelzenmueller

BUILDING ISSUES

ADA: Parking stalls shall be dimensioned on submittal for permits. ADA ramp at top of side aisle encroaches into walking path. Provide a clear and flat aisle with a minimum of 3 feet clear path. ADA signage shall comply with ANSI A117.1 and Chapter 11 of the Oregon Structural Specialty Code.

Structural: NA
Mechanical: NA
Plumbing: NA
Plumb Site Utilities: Provide a complete site drainage (underground storm) at time of permit submittal
Electrical: TBD. The parking lot lighting electrical permit shall go through Clackamas Co for review and

permits

Notes: Fire Department has submitted comments separately

Please note all drawings must be individually rolled. If the drawings are small enough to fold they must be individually folded.

FIRE MARSHAL ISSUES

Fire Sprinklers: NA

Fire Alarms: NA

Fire Hydrants:

Turn Arounds:

Addressing:

Fire Protection:

Fire Access:

Hazardous Mat.:

Fire Marshal Notes: See attached.

PUBLIC WORKS ISSUES

Water: Not Applicable at this time in the development process.

Sewer: Not Applicable at this time in the development process.

Storm: Submission of a storm water management plan by a qualified professional engineer is required as part of the proposed development. The plan shall conform to Section 2 - Stormwater Design Standards of the City of Milwaukie Pubic Works Standards.

The storm water management plan shall demonstrate that the post-development runoff does not exceed the pre-development, including any existing storm water management facilities serving the development property. Also, the plan shall demonstrate compliance with water quality standards. The City of Milwaukie has adopted the City of Portland 2008 Stormwater Management Manual for design of water quality facilities.

All new impervious surfaces, including replacement of impervious surface with new impervious surfaces, are subject to the water quality standards. See City of Milwaukie Public Works Standards for design and construction standards and detailed drawings.

The storm SDC is based on the amount of new impervious surface constructed at the site. One storm SDC unit is the equivalent of 2,706 square feet of impervious surface. The storm SDC is currently \$765 per unit. The storm SDC will be assessed and collected at the time the building permits are issued.

Street: Not Applicable at this time in the development process.

Frontage: Not Applicable at this time in the development process.
Right of Way: Not Applicable at this time in the development process.
Driveways: Not Applicable at this time in the development process.
Erosion Control: Not Applicable at this time in the development process.
Traffic Impact Study: Not Applicable at this time in the development process.
PW Notes: OTHER SYSTEM DEVELOPMENT CHARGES

The Transportation SDC will be based on the increase in trips generated by the new use per the Trip Generation Handbook from the Institute of Transportation Engineers. The SDC for transportation is \$1,741.00 per trip generated. Credits will be given for any demolished structures, which shall be based upon the existing use of the structures.

The Parks and Recreation SDC is assessed for both residential and nonresidential development. Currently, the Parks and Recreation SDC for residential development is \$3,985.00 for each single-family dwelling unit and \$3,608.00 for each multi-family dwelling unit. The Parks and Recreation SDC of nonresidential development is calculated on the number of employees according to type of business and building square feet and is \$60.00 per employee.

PLANNING ISSUES

Setbacks: No new building is proposed, so there are no relevant setback standards.

Landscape: There is no minimum required landscaping for the Downtown Office zone, though there are landscaping requirements for off-street parking areas. See the "Parking" section for more details.

Parking: Milwaukie Municipal Code (MMC) Chapter 19.600 provides standards for off-street parking areas. MMC Table 19.605.1 establishes minimum and maximum numbers of spaces. For general office uses, a minimum of 2 spaces are required per 1,000 square feet of area; a maximum of 3.4 spaces are allowed per 1,000 square feet of area. According to past documentation, there are approximately 57,000 square feet of office, which results in a minimum requirement of 114 spaces and a maximum allowance of 194 spaces.

In 2004, the City approved a request to exceed the maximum amount of allowed parking by 8 spaces, to a total of 202. According to the applicant, the site currently provides 206 parking spaces, with 56 spaces in a lot on the east side of the office building and 150 spaces in a lot on the west side of the building. The proposed development would increase the total number of spaces to approximately 236. In MMC 19.605.2, the current code provides a process for modifying the maximum allowed number of spaces, which involves providing data and analysis to support the request. MMC 19.605.3.A provides exemptions to the maximum quantity allowance. Parking spaces that are designated specifically for employee carpool parking or for fleet vehicles are not counted toward the maximum allowance.

As per MMC 19.602.4.A, parking areas developed to serve existing uses must meet the various standards for such features as dimensions, landscaping, and pedestrian access. For perpendicular (90-degree) spaces, stalls must be at least 9 feet wide and 18 feet deep, with a 22-foot drive aisle. In downtown zones, there is no perimeter landscaping required adjacent to other properties; a 4-foot perimeter buffer is required where adjacent to public right-of-way. At least 25 square feet per parking space must be provided as interior landscaping, with each planting area at least 6 feet wide and at least

120 square feet in area. One tree is required along each lineal 40 feet of landscaping areas

Transportation Review: Please see the Public Works notes for more information about the applicability of MMC 19.700 Public Facility Improvements and any required right-of-way dedication and street improvements.

Application Procedures: The proposed development would involve the following land use applications:
Parking Determination
Downtown Design Review
Willamette Greenway
Natural Resources
Development Review

Parking Quantity Determination (MMC 19.605.2) = The proposed development must obtain approval to exceed the maximum number of allowed parking spaces. Such a request requires Type II review, with the Planning Director as the deciding authority. The application requirements and approval criteria are provided in MMC 19.605.2.B and 2.C, respectively.

Downtown Design Review (MMC 19.907) = Construction of an expanded parking lot triggers Type III review and a public hearing before the Planning Commission. A recommendation meeting with the Design and Landmarks Committee (DLC) will be required prior to a hearing and decision by the Planning Commission. The DLC regularly meets on the first Monday of each month. As new construction, the proposed development is subject to the design standards of MMC 19.304.6.C; however, those standards are intended for buildings and are not applicable to the proposed parking area. The application narrative should address all relevant design guidelines (e.g., for Milwaukie Character, Pedestrian Emphasis, Lighting, etc.). A completed Design Review checklist should be submitted with the application, to indicate which standards and guidelines are addressed in the application narrative.

Willamette Greenway (MMC 19.401) = Most of the western parking lot is within the Willamette Greenway overlay. Construction to expand the parking lot requires Type III review against the approval criteria of MMC 19.401.6. The applicant should address all relevant Willamette Greenway approval criteria, such as those relating to urban use, the State Willamette River Greenway Plan, and protection of the environment as per MMC 19.402 Natural Resources.

Natural Resources (MMC 19.402) = A portion of the western parking lot includes a designated Habitat Conservation Area (HCA) and is subject to the protections of MMC 19.402. As per MMC 19.402.11.D.1.b, up to 10 percent of the total HCA-only areas on the site can be disturbed using the Type I nondiscretionary review process, as long as the required number of mitigation plantings are provided as per MMC 19.402.11.D.2. Where the HCA on site overlaps with any water quality resource (WQR) area, those overlapping areas do not count as HCA-only. Mitigation includes tree replacement based on either the size of trees removed or the size of area disturbed, whichever results in requiring more trees. "Disturbance" includes both permanent disturbance (i.e., loss of HCA to development) and temporary disturbance for construction activity.

Development Review (MMC 19.906) = If the proposed parking improvements and associated downtown design and greenway reviews are approved, Type I Development Review will be required with the submittal of any needed development permits (such as for grading and erosion control), to ensure that all relevant standards are met and that any required conditions of approval are carried out.

The City allows multiple land use applications to be processed either concurrently or individually, as per MMC 19.1001.6.B. The applicant has indicated an interest in expediting the process and may choose to bundle the Downtown Design Review (Type III), Willamette Greenway (Type III), and Parking Quantity Determination (Type II) applications for concurrent review through the Type III process. The Type I Natural Resources review for HCA disturbance can be handled separately from that

bundle of applications but would be processed in conjunction with the necessary Type I Development Review application at the time of building permit submittal.

For multiple applications, the most expensive fee is collected in full, with a 25-percent discount for each additional application. For the current fiscal year (until June 30, 2014), the following fees are in effect for the various levels of land use application review: Type I (\$200), Type II (\$1,000), and Type III (\$2,000). There is a \$500 fee for appealing any decision to the relevant appeal authority listed in MMC Table 19.1001.5

Natural Resource Review: Johnson Creek passes through the subject property, resulting in several designated areas of Water Quality Resource (WQR) and Habitat Conservation Area (HCA).

Lot Geography: The subject property is approximately 314,000 square feet in area (7.2 acres) and is irregularly shaped. Johnson Creek runs along the eastern boundary in meandering fashion, isolating one small piece of the property from the rest of the site. On the north, the lot is bounded by SE Lava Drive; on the west, it is bounded by SE Riverway Lane. Extending approximately 400 feet from the intersection with Lava Dr, Riverway Ln is public right-of-way with a 15-foot width; along the southern boundary of the site, Riverway Ln is a private access road.

Planning Notes: As part of making the case for approval to exceed the maximum allowed parking quantity, the applicant is encouraged to address any existing transportation demand management (TDM) practices employed by the current business at the site (Moda Health). The Planning Commission will likely want to know whether Moda currently offers transit passes, carpooling programs, bicycle amenities (such as inside bike parking, lockers, showers, etc.), shuttle services, or other incentives to reduce parking demand. With the imminent opening of light rail (Fall 2015) and the soon-to-come construction of a multiuse path on 17th Ave near the subject property, there may be questions from the Commission about whether it is necessary to approve the requested parking increase.

ADDITIONAL NOTES AND ISSUES

County Health Notes:

Other Notes:

This is only preliminary preapplication conference information based on the applicant's proposal and does not cover all possible development scenarios. Other requirements may be added after an applicant submits land use applications or building permits. City policies and code requirements are subject to change. If you have any questions, please contact the City staff that attended the conference (listed on Page 1). Contact numbers for these staff are City staff listed at the end of the report.

Sincerely,

City of Milwaukie Development Review Team

BUILDING DEPARTMENT

John Stelzenmueller - Building Official - 503-786-7611

Bonnie Lanz - Permit Specialist - 503-786-7613

ENGINEERING DEPARTMENT

Jason Rice - Engineering Director - 503-786-7605

Brad Albert - Civil Engineer - 503-786-7609

Adriana Slavens - Civil Engineer - 503-786-7602

Philip Kolb - Engineering Technician II - 503-786-7610

Alex Roller - Engineering Technician I - 503-786-7695

COMMUNITY DEVELOPMENT DEPARTMENT

Stephen Butler - Community Development Director - 5

Marcia Hamley - Admin Specialist - 503-786-7656

Alicia Martin -Admin Specialist - 503-786-7600

Blanca Marston -Admin Specialist - 503-786-7600

PLANNING DEPARTMENT

Dennis Egner - Planning Director - 503-786-7654

Ryan Marquardt - Senior Planner - 503-786-7658

Brett Kelter - Associate Planner - 503-786-7657

Li Alligood - Associate Planner - 503-786-7627

Vera Kolias - Associate Planner - 503-786-7653

CLACKAMAS FIRE DISTRICT

Mike Boumann - Lieutenant Deputy Fire Marshal - 503-742-2673

Clackamas County Fire District #1

Fire Prevention Office



E-mail Memorandum

To: City of Milwaukie Planning Department
From: Shawn Olson, Clackamas Fire District #1
Date: 04/16/2014
Re: 10505 SE 17th Ave, Moda Health Parking Lot Expansion

This review is based upon documents submitted by the applicant. The comments we provide are intended as an advisory to the applicant until final design documents are submitted for formal review at the County. While the scope of this review is typically limited to fire apparatus access and water supply, the applicant must comply with all applicable Fire Code requirements. The following access and water supply requirements shall be addressed on the formal submittal.


Fire Apparatus Access

1. "No Parking Fire Lane" signs shall be placed on one or both sides of a fire apparatus access road when road widths are less than 26 feet wide and 26 feet to 32 feet in width. Signs shall be placed on both sides of a fire apparatus access road when roads are less than 26 feet in width and on one side when roads are 26 feet to 32 feet in width. Red painted curbs can be used in lieu of signs.
2. Provide turning radius dimensions on submitted plans. The inside turning radius and outside turning radius for a 20 feet wide road shall be not less than 28 feet and 48 feet respectively, measured from the center point

Appendix B



HanmiGlobal Partner



April 12, 2000

File(s): MU-00-01

NOTICE OF DECISION

This is official notice of action taken by the Milwaukie Planning Commission on April 11, 2000.

Applicant(s): Oregon Dental Service
Location(s): 10505 SE Lava Drive
Tax Lot(s): 11E 35AA 03500
Application Type(s): Mixed Use Overlay, Variance, Willamette Greenway Conditional Use, Natural Resource Overlay, Transportation Plan Review
Decision: APPROVED
Review Criteria: Milwaukie Zoning Ordinance:

- 318-Mixed Use Overlay Zone MU
- 320-Willamette Greenway Zone WG
- 322-Natural Resource Overlay Zone NR
- 500-Offstreet Parking and Loading
- 600-Conditional Uses
- 700-Variances, Exceptions, and Home Improvement Exceptions
- 1011.3- Minor Quasi-Judicial Review
- 1400-Transportation Planning, Design Standards and Procedures

The Planning Commission's decision on this matter may be appealed to the Milwaukie City Council. An appeal of this action must be filed within 15 days of the date of this notice. All appeals must be accompanied by the applicable fee, be submitted in the proper format, address applicable criteria, and be made on forms provided by the Planning Department. Milwaukie Planning staff (786-7600) can provide information regarding forms, fees, and the appeal process.

Appeal expiration date: 5:00 p.m., April 27, 2000

FINDINGS IN SUPPORT OF APPROVAL

1. The applicant is proposing to make building improvements of 58,000 square feet for office use and related parking and site improvements for office occupancy at 10505 SE

COMMUNITY DEVELOPMENT DEPARTMENT
Public Works • Planning • Building • Fleet • Facilities
6101 SE Johnson Creek Blvd., Milwaukie, Oregon 97206
PHONE: (503) 786-7600 • FAX: (503) 774-8236

Lava Drive. The improvements involve architectural alterations including enclosing approximately 15,000 square of covered parking, demolition of 2,200 square feet, new offices spaces, executive offices, conference center, lunchroom, new windows, skylights, and exterior finishes. Site improvements include parking, lighting, and landscaping, pedestrian walkways, half-street improvements, and right-of-way dedications on Lava Drive.

2. All applications have been processed, and public notice provided, in accordance with Zoning Ordinance (ZO) Section 1011.3-Minor Quasi Judicial Review.
3. All applications have been processed in accordance with specific procedural requirements of each applicable zoning section.
4. The applicant has requested a variance of the requirements of ZO Section 318.8.A.2 and 318.9.D to provide first floor retail or service uses and to provided housing as part of the development proposal.
5. Application VR-00-01 meets ZO Section 702.1-Criteria for Granting Variances as follows:
 - a. The Commission accepts the applicant's explanation of compliance with 702.1.A and finds that the characteristics of building design and building placement are unusual conditions over which the applicant has no control. The existing building is unsuitable for development of required first floor and residential uses due to its physical constraints, and significant cost of renovation to make it suitable for the required first floor and residential uses.
 - b. The Commission finds that there are no economically feasible alternatives to the variance and that the variance does not allow greater use of the property than similarly situated properties. Reuse of the building for any occupancy is expected to require improvements as needed to meet code requirements or make the building functional for the intended occupancy. Since any building improvement that either changes the exterior of the building or results in an intensification of use, requires compliance with first floor and residential use provisions of Section 318.8.A.2 and 318.8.D, there are no alternatives that allow reasonable economic use of the building.
 - c. The Commission finds that there will be no discernable impacts on other properties as a result of granting the variance of the requirement to provide first floor retail or service uses and residential uses.
6. Except for the first floor and residential use requirements, for which a variance has been granted, application MU-00-01 meets the requirements of the ZO Section 318-Mixed Use Zone.
7. Application WG-00-01 meets the requirements of ZO Section 320-Willamette Greenway Zone and ZO Section 600-Conditional Uses.

8. As conditioned, application NR-00-02 meets, or can meet, the requirements of ZO Section 322-Natural Resource Overlay. With proper location and design of structures and control of construction activities, setbacks are adequate to ensure protection of resources. Compliance with Section 322.7.A.5 provisions that require protection of natural resource areas from site lighting is feasible with proper design and location of lighting. Compliance with Section 322.7.B.8 requirements to minimize adverse impacts on natural features is feasible with proper design and placement of stormwater drainage out falls.
9. The applicant has proposed improvements that include the following:
 - a. pedestrian connection between the building and 17th Avenue located along the southern side of the parking lot;
 - b. half street improvements along the property frontage on Lava Drive that include curb, curb tight sidewalk, paving, striping, dedicated left and right turn lanes;
 - c. relocation of a TRI-MET bus stop and construction of a bus shelter, bench and other reasonable transit facilities;
 - d. landscape planting to establish a buffer between the building and Johnson Creek;
 - e. site lighting that does not create glare or shine on adjacent properties;
 - f. required design elements of Section 318.8.19 as follows:
 1. pedestrian scale lighting along walkways,
 2. historical plaque recognizing Pendelton's historical use of the site,
 3. street furniture (benches) on Lava Drive,
 4. enhanced transit amenities,
 5. enhanced pedestrian walkways, and
 6. decorative drinking fountain along Lava Drive.
 - g. interior storage of refuse and recycling containers ; and
 - h. covered bicycle parking.
10. As conditioned, the parking plan complies with parking lot design, lighting, and landscaping requirements of Section 500-Offstreet Parking and Loading. The proposed parking plan does not meet requirements for interior landscaping islands. Modification of the parking plan to meet interior island requirements of Section 503.19 is feasible. Parking lot lighting is required to be located and designed to ensure safety while not resulting in impacts to adjoining properties pursuant to ZO Section 503.15. Site lighting required by Section 503.15 can be provided reasonably and feasibly.
11. As conditioned the site plan complies with ZO Section 503.12 concerning number of curb cuts. The existing curb cut on 17th Avenue is deemed potentially unsafe due to its proximity to Lava Drive. Under congested conditions the driveway intersection may

cause traffic, pedestrian, or cyclist safety hazards. Accordingly, abandonment of the driveway curb cut is warranted.

12. The applicant is proposing to save certain existing trees located within parking areas. Preservation of existing trees is encouraged under ZO 503.19.D.
13. Section 1405-Transportation Planning, Design Standards, and Procedures, Sidewalks allows for sidewalks to be curb-tight when adequate right-of-way is not available. The applicant has indicated right-of-way will be dedicated as needed for required half-street improvements. Curb tight sidewalks are acceptable along Lava Drive in order to minimize the area of dedication for right-of-way.

CONDITIONS OF APPROVAL

1. Final site and architectural development plans shall be in substantial conformance with plans submitted for land use approval. Reference is made to development plans entitled Figure 4 through Figure 11, architectural drawings entitled Figures A through E (composite), application submission materials, and minutes of the Planning Commission's public hearing.
2. Prior to issuance of a building permit the applicant shall submit to the satisfaction of the Planning Director, a detailed narrative description of all actions taken to comply with conditions of this approval. The report shall address each condition and describe changes made in response. The report shall also describe all changes that were made, but which were not required by this approval. Any changes deemed to be in excess of, or that are inconsistent with this approval may require review by the Planning Commission subject to the Planning Director's discretion.
3. Prior to issuance of a building permit, final development plans shall be submitted to the satisfaction of the Planning Director for determination of consistency with the plans approved by the Planning Commission.
4. Prior to issuance of a building permit, a grading plan showing existing and proposed grades and elevations of all retaining walls shall be submitted to the satisfaction of the Planning Director.
5. Prior to issuance of a building permit, development plans showing final design details of the southern sidewalk and its intersection with the 17th Avenue sidewalk and the existing vehicle barrier along the Lava Drive sidewalk, shall be submitted to the mutual satisfaction of the Public Works Director, Planning Director, and if required, Oregon Department of Transportation. The plans shall indicate all required fill, structures and drainage facilities. Fill within the Natural Resource area shall be minimized to the greatest extent practicable. Construction impacts shall be mitigated by erosion control methods. Any earth disturbance within the NR boundary shall be restored with native plant materials, including but not limited to native ground cover.

6. Prior to issuance of a building permit the applicant shall submit approval of Tri-Met to relocate the bus stop.
7. Prior to issuance of a building permit, the applicant shall submit transit stop construction plans to the mutual satisfaction of the Public Works Director, Planning Director, and if needed, Tri-Met. The facility shall include ADA improvements.
8. Prior to the issuance of building permit, the applicant shall submit a detailed and dimensioned parking plan. All spaces, aisles, planter islands, wheels stops, and other required features shall be provided and designed in accordance with ZO Section 500- Offstreet Parking and Loading.
9. Prior to issuance of a building permit, the applicant shall submit a detailed parking lot and pedestrian walkway lighting plan. Lighting shall be provided along the southern sidewalk pursuant to Section 500. Trespass lighting on the Natural Resource area is prohibited pursuant to Section 322-Natural Resource Overlay Zone. Glare and trespass lighting impacts on adjoining properties is prohibited pursuant to Section 503.15. The lighting plan shall specify mounting height, fixture and lamp types. Photometrics shall be provided for each type of installation.
10. Prior to issuance of a building permit the applicant shall submit a tree preservation plan for all areas affected by parking lot construction. The plan is to identify appropriate tree protection measures, excavations, fills, utility trenches, material and equipment storage, and tree protection measures.
11. Prior to issuance of a building permit, the applicant shall submit an erosion control and construction barrier plan to the mutual satisfaction of the Planning Director and Public Works Director. Construction barriers shall be located at appropriate locations along the top-of-bank of Johnson Creek to prevent encroachment within the natural resource area. Construction barriers shall be of substantial construction and shall be securely installed.
12. Prior to issuance of a building permit, the applicant shall submit construction plans to the mutual satisfaction of the Fire Marshal and Building Official.
13. Prior to issuance of a building permit, all required permit and system development charges shall be paid.
14. Prior to issuance of a building permit, the applicant shall submit instruments for dedication of Lava Drive right-of-way to the mutual satisfaction of the Public Works Director, Planning Director, and City Attorney.
15. Prior to issuance of a building permit, the applicant shall submit to the mutual satisfaction of the Planning Director and Public Works Director, construction plans for Lava Drive half street improvements including curb tight sidewalk, curb, drainage, paving, striping, and dedicated north and south bound turn lanes. The sidewalk shall be no less than 6 feet in width exclusive of the curb pursuant to ZO Section 1405. The plans shall also indicate appropriate tree preservation measures.

16. Prior to issuance of a building permit the applicant shall submit a plan to the satisfaction of the Public Works Director showing abandonment of the 17th Avenue curb cut and restoration of curb and sidewalk.
17. Prior to issuance of building permit, all public improvements shall be bonded to the satisfaction of the Public Works Director.
18. Prior to issuance of a building permit, the applicant shall submit detailed construction plans for all elements proposed under Section 318.8.A.19-Design Standards, "essential elements".
19. Prior to inspections for final occupancy, the dedication of land for public right-of-way shall be executed. Copies of all related maps and filings be submitted to the Planning Director, and Public Works Director, and City Attorney.
20. Prior to any inspection for final occupancy, all landscaping improvements shall be completed unless, bonding of landscaping improvements is submitted to the satisfaction of the Planning Director pursuant to Section 503.19.E.
21. Prior to issuance of a building permit, the applicant shall submit instruments for dedication of Lava Drive right-of-way to the mutual satisfaction of the Public Works Director, Planning Director, and City Attorney.
22. Prior to any inspections for temporary occupancy, all public improvements shall be completed and inspected to the satisfaction of the Public Works Director.
23. Prior to approval being issued for temporary or final certificate of occupancy, the applicant shall submit to the Planning Director a detailed narrative of all actions taken to comply with all conditions of this approval. The Planning Director shall conduct a site inspection and other investigations as needed to ensure compliance with conditions of this approval prior to granting occupancy approvals.
24. Prior to issuance of final occupancy approvals, all improvements proposed to meet design criteria of Section 318.8.A.19 ("essential requirements") shall be completed and inspection to the satisfaction of the Planning Director.



Alice Rouyer
Planning Director

cc: Applicant
Planning Commission
Martha Bennett, Assistant City Manager, CD
Sue Stepan, Public Works Director
Paul Roeger, P.E., Civil Engineer
John Wheeler, Building Official

Bonnie Lanz, Permit Specialist
Tom Crowder, Deputy Fire Marshal
Historic Milwaukie NDA
Interested Persons
File

Appendix C



HanmiGlobal Partner



PLANNING DEPARTMENT
6101 SE Johnson Creek Blvd
Milwaukie OR 97206

PHONE: 503-786-7630
FAX: 503-774-8236
E-MAIL: planning@milwaukieoregon.gov

Application for Land Use Action

Master File #: _____

Review type*: I II III IV V

CHECK ALL APPLICATION TYPES THAT APPLY:		
<input type="checkbox"/> Amendment to Maps and/or Ordinances:	<input type="checkbox"/> Land Division:	<input type="checkbox"/> Planned Development
<input type="checkbox"/> Comprehensive Plan Text Amendment	<input type="checkbox"/> Final Plat	<input type="checkbox"/> Residential Dwelling:
<input type="checkbox"/> Comprehensive Plan Map Amendment	<input type="checkbox"/> Lot Consolidation	<input type="checkbox"/> Accessory Dwelling Unit
<input type="checkbox"/> Zoning Text Amendment	<input type="checkbox"/> Partition	<input type="checkbox"/> Duplex
<input type="checkbox"/> Zoning Map Amendment	<input type="checkbox"/> Property Line Adjustment	<input type="checkbox"/> Manufactured Dwelling Park
<input type="checkbox"/> Code Interpretation	<input type="checkbox"/> Replat	<input type="checkbox"/> Temporary Dwelling Unit
<input type="checkbox"/> Community Service Use	<input type="checkbox"/> Subdivision	<input type="checkbox"/> Sign Review
<input type="checkbox"/> Conditional Use	<input type="checkbox"/> Miscellaneous:	<input type="checkbox"/> Transportation Facilities Review
<input type="checkbox"/> Development Review	<input type="checkbox"/> Barbed Wire Fencing	<input type="checkbox"/> Variance:
<input type="checkbox"/> Director Determination	<input type="checkbox"/> Bee Colony	<input type="checkbox"/> Use Exception
<input checked="" type="checkbox"/> Downtown Design Review	<input type="checkbox"/> Mixed Use Overlay Review	<input type="checkbox"/> Variance
<input type="checkbox"/> Extension to Expiring Approval	<input type="checkbox"/> Modification to Existing Approval	<input checked="" type="checkbox"/> Willamette Greenway Review
<input type="checkbox"/> Historic Resource:	<input type="checkbox"/> Natural Resource Review	<input type="checkbox"/> Other: _____
<input type="checkbox"/> Alteration	<input type="checkbox"/> Nonconforming Use Alteration	Use separate application forms for:
<input type="checkbox"/> Demolition	<input checked="" type="checkbox"/> Parking:	• Annexation and/or Boundary Change
<input type="checkbox"/> Status Designation	<input type="checkbox"/> Quantity Determination	• Compensation for Reduction in Property Value (Measure 37)
<input type="checkbox"/> Status Deletion	<input checked="" type="checkbox"/> Quantity Modification	• Daily Display Sign
	<input type="checkbox"/> Shared Parking	• Appeal
	<input type="checkbox"/> Structured Parking	

RESPONSIBLE PARTIES:

APPLICANT (owner or other eligible applicant—see reverse): <u>Moda Health</u>	
Mailing address: <u>601 SW Second Avenue, Portland, OR</u>	Zip: <u>97204</u>
Phone(s): <u>503-948-5564</u>	E-mail: <u>david.shaffer@modahealth.com</u>
APPLICANT'S REPRESENTATIVE (if different than above): <u>Otak, Inc. (Jerry Offer)</u>	
Mailing address: <u>808 SW Third Avenue, Suite 300, Portland, OR</u>	Zip: <u>97204</u>
Phone(s): <u>503-415-2330</u>	E-mail: <u>jerry.offer@otak.com</u>

SITE INFORMATION:


Address: <u>10505 SE Lava Drive</u>	Map & Tax Lot(s): <u>11E 35AA TL 03500</u>
Comprehensive Plan Designation: <u>Downtown</u> Zoning: <u>DO/WG/NR</u> Size of property: _____	

PROPOSAL (describe briefly):

A request for the following approvals: (1) Downtown Design Review; (2) Willamette Greenway Use; and (3) a Modification to the maximum permitted parking for a 58,500 sq. ft. office use. Moda Health seeks to add thirty parking spaces to their existing western parking area.

SIGNATURE:

ATTEST: I am the property owner or I am eligible to initiate this application per Milwaukie Municipal Code (MMC) Subsection 19.1001.6.A. If required, I have attached written authorization to submit this application. To the best of my knowledge, the information provided within this application package is complete and accurate.

Submitted by:  Date: 4-7-14

IMPORTANT INFORMATION ON REVERSE SIDE



PLANNING DEPARTMENT
6101 SE Johnson Creek Blvd
Milwaukie OR 97206

PHONE: 503-786-7630
FAX: 503-774-8236
E-MAIL: planning@milwaukieoregon.gov

For all Land Use Applications
(except Annexations and Development Review)

Submittal Requirements

All land use applications must be accompanied by a signed copy of this form (see reverse for signature block) and the information listed below. The information submitted must be sufficiently detailed and specific to the proposal to allow for adequate review. Failure to submit this information may result in the application being deemed incomplete per the Milwaukie Municipal Code (MMC) and Oregon Revised Statutes.

Contact Milwaukie Planning staff at 503-786-7630 or planning@milwaukieoregon.gov for assistance with Milwaukie's land use application requirements.

1. **All required land use application forms and fees**, including any deposits.
Applications without the required application forms and fees will not be accepted.
2. **Proof of ownership or eligibility to initiate application** per MMC Subsection 19.1001.6.A.
Where written authorization is required, applications without written authorization will not be accepted.
3. **Detailed and comprehensive description** of all existing and proposed uses and structures, including a summary of all information contained in any site plans.
Depending upon the development being proposed, the description may need to include both a written and graphic component such as elevation drawings, 3-D models, photo simulations, etc. Where subjective aspects of the height and mass of the proposed development will be evaluated at a public hearing, temporary on-site "story pole" installations, and photographic representations thereof, may be required at the time of application submittal or prior to the public hearing.
4. **Detailed statement** that demonstrates how the proposal meets all applicable application-specific approval criteria (check with staff) and all applicable development standards (listed below):
 - a. **Base zone standards** in Chapter 19.300.
 - b. **Overlay zone standards** in Chapter 19.400.
 - c. **Supplementary development regulations** in Chapter 19.500.
 - d. **Off-street parking and loading standards and requirements** in Chapter 19.600.
 - e. **Public facility standards and requirements**, including any required street improvements, in Chapter 19.700. *N.A.*
5. **Site plan(s), preliminary plat, or final plat** as appropriate.
See Site Plan, Preliminary Plat, and Final Plat Requirements for guidance.
6. **Copy of valid preapplication conference report**, when a conference was required.

Have not yet received this

APPLICATION PREPARATION REQUIREMENTS:

- Five copies of all application materials are required at the time of submittal. Staff will determine how many additional copies are required, if any, once the application has been reviewed for completeness.
- All application materials larger than 8½ x 11 in. must be folded and be able to fit into a 10- x 13-in. or 12- x 16-in. mailing envelope.
- All application materials must be collated, including large format plans or graphics.

ADDITIONAL INFORMATION:

- Neighborhood District Associations (NDAs) and their associated Land Use Committees (LUCs) are important parts of Milwaukie's land use process. The City will provide a review copy of your application to the LUC for the subject property. They may contact you or you may wish to contact them. Applicants are strongly encouraged to present their proposal to all applicable NDAs prior to the submittal of a land use application and, where presented, to submit minutes from all such meetings. NDA information: <http://www.milwaukieoregon.gov/communityservices/neighborhoods-program>.
- Submittal of a full or partial electronic copy of all application materials is strongly encouraged.

As the authorized applicant I, (print name) Jerry D. Offer of Otak, Inc., attest that all required application materials have been submitted in accordance with City of Milwaukie requirements. I understand that any omission of required items or lack of sufficient detail may constitute grounds for a determination that the application is incomplete per MMC Subsection 19.1003.3 and Oregon Revised Statutes 227.178. I understand that review of the application may be delayed if it is deemed incomplete.


Furthermore, I understand that, if the application triggers the City's sign-posting requirements, I will be required to post signs on the site for a specified period of time. I also understand that I will be required to provide the City with an affidavit of posting prior to issuance of any decision on this application.

Applicant Signature: Jerry Offer Otak, Inc.

Date: April 21, 2014

Official Use Only

Date Received (date stamp below):

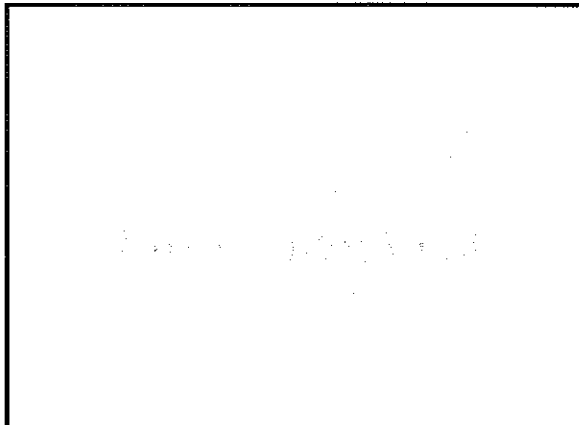

DOWNTOWN DESIGN REVIEW CHECKLIST

Project/Applicant Name: MODA Health Parking Revisions / MODA Health
 Project Address: 10505 SE 17th Avenue.
 Application Submission Date: April 11, 2014
 Zoning: DO Willamette Greenway and Natural Resource Overlay Zones on portion
 Building Use: Administrative Offices for health insurance firm.
 Completed By: Jerry Offer, Otak, Inc. on: April 21, 2014

STANDARDS AND GUIDELINES

A. Development and Design Standards Complies
Yes No NA

1. Development Standards

a. Permitted Use	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
b. Minimum Lot Size	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
c. Floor Area Ratio	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
d. Building Height	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
e. Residential Density	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
f. Street Setbacks	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
g. Side and Rear Setbacks	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
h. Ground-floor Retail	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
i. Ground-floor Windows/Doors	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
j. Drive-through Facilities	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
k. Off-street Parking Requirements	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
l. Landscaping	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

2. Design Standards

a. Residential Entries and Porches	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
b. Garages and Parking Areas	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
c. Courtyards	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
d. Balconies	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
e. Walls	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
f. Windows	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
g. Roofs	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

subject to modification req

B. Design Guidelines

1. Milwaukie Character

a. Reinforce Milwaukie's Sense of Place	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
b. Integrate the Environment	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
c. Promote Linkages to Horticultural Heritage	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
d. Establish or Strengthen Gateways	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
e. Consider View Opportunities	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
f. Consider Context	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
g. Promote Architectural Compatibility	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
h. Preserve Historic Buildings	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
i. Use Architectural Contrast Wisely	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
j. Integrate Art	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>

sort of

DOWNTOWN DESIGN REVIEW CHECKLIST

Complies

- | | Yes | No | NA |
|--|-------------------------------------|--------------------------|-------------------------------------|
| 2. Pedestrian Emphasis | | | |
| a. Reinforce and Enhance the Pedestrian System | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| b. Define the Pedestrian Environment | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| c. Protect the Pedestrian from the Elements | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| d. Provide Places for Stopping and Viewing | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| e. Create Successful Outdoor Spaces | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| f. Integrate Barrier-Free Design | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| 3. Architecture | | | |
| a. Corner Doors | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| b. Retail and Commercial Doors | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| c. Residential Doors | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| d. Wall Materials | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| e. Wall Structure | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| f. Retail Windows | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| g. Residential Bay Windows | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| h. Silhouette and Roofline | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| i. Rooftops | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| j. Green Architecture | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| k. Building Security | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| l. Parking Structures | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| 4. Lighting* | | | |
| a. Exterior Building Lighting | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| b. Parking Lot Lighting | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| c. Landscape Lighting | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| d. Sign Lighting | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| 5. Signs | | | |
| a. Wall Signs | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| b. Hanging or Projecting Signs | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| c. Window Signs | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| d. Awning Signs | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| e. Information and Guide Signs | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| f. Kiosk Monument Signs | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |
| g. Temporary Signs | <input type="checkbox"/> | <input type="checkbox"/> | <input checked="" type="checkbox"/> |

Notes:

Appendix D



HanmiGlobal Partner



FEATURES & SPECIFICATIONS

INTENDED USE — Ideal for car lots, street lighting or parking areas.

CONSTRUCTION — Rugged, .063" thick, aluminum rectilinear housing. Formed for weather-tight seal and integrity. Naturally anodized, extruded aluminum door frame with mitered corners, is retained with two .188" diameter hinge pins and secured with one quarter-turn, quick-release fastener. Weatherproof seal between housing and door frame is accomplished with an integrally designed, extruded silicone gasket that snaps into the door frame, and another gasket applied to the housing.

Finish: Standard finish is dark bronze (DDB), polyester powder finish with other architectural colors available.

OPTICS — Reflectors are anodized and segmented for superior uniformity and control. Reflectors attach with tool-less fasteners and are rotatable and interchangeable. Five cutoff distributions available: Type II (roadway), Type III (asymmetric), Type IV (forward throw, sharp cutoff), Type IV (wide, forward throw), Type V (square). Lens is .125" thick impact-resistant tempered glass with thermally applied silk-screened shield.

ELECTRICAL — Ballast: Constant wattage autotransformer for 250-400W. Super CWA pulse-start ballast required for 320W and 350W (SCWA option). Super CWA (pulse start ballast), 88% efficient and EISA legislation compliant, is required for 250-400W (SCWA option) for U.S. shipments only, CSA or INTL required for probe-start shipments outside the U.S.

Ballasts are 100% factory-tested.

Socket is porcelain, horizontally mounted mogul base socket with copper alloy, nickel-plated screw shell and center contact. UL listed 1500W-600V.

INSTALLATION — Extruded aluminum arm for pole or wall mounting is shipped in fixture carton. Optional mountings available.


LISTING — UL listed (standard). CSA Certified (see Options). NOM Certified (see Options). UL listed for 25°C ambient temperature and wet locations. IP65 rated.

WARRANTY — 1-year limited warranty. Complete warranty terms located at

www.acuitybrands.com/CustomerResources/Terms_and_conditions.aspx

Note: Specifications subject to change without notice.


Catalog Number
Notes
Type



Specifications

EPA: 2.0 ft² (.28 m²) (includes arm)
 Length: 24-19/32 (62.5)
 Width: 17-25/32 (62.5)
 Depth: 8-5/16 (21.1)
 Arm: 4 (10.2)
 *Weight: 52 lbs (23.6 kg)
 *Weight as configured in example below.
 All dimensions are inches (centimeters) unless otherwise specified.

Area Lighting
KSF2
 METAL HALIDE: 250-400W
 HIGH PRESSURE SODIUM: 200-400W
 15' to 25' Mounting

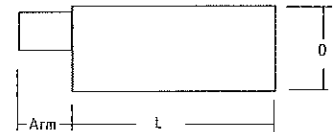

Mounting option	Drilling template
SPxx, RPxx, DA12P	5
WBxx, DA12WB	6
WWxx	7

ORDERING INFORMATION For shortest lead times, configure product using bolded options.

Example: KSF2 400M R3 TB SCWA SP04 LPI

KSF2 Series	Wattage	Distribution		Voltage		Ballast		Mounting					
		R2	Type II roadway	120	347	(blank)	Magnetic	Type	Arm length ⁹	Shipped separately			
KSF2	Metal halide	R3	Type III asymmetric	208 ⁶	480 ⁶	CWI	Constant wattage Isolated	SP	Square pole	04	4" arm	DA12P	Degree arm, pole
	250M ¹ 350M ^{2,3,4}	R4SC	Type IV forward throw, sharp cutoff	240 ⁶	TB ⁷	Pulse Start		RP	Round pole	06	6" arm	DA12WB	Degree arm, wall
	High pressure sodium⁵	R4W	Type IV wide, forward throw	277	23050HZ ⁸	SCWA	Super CWA pulse-start ballast	WB	Wall bracket	09	9" arm	KMA	Mast arm adapter
	200S 400S	R5S	Type V square					WW	Wood pole or wall bracket	12	12" arm	KTMB	Twin mounting bar
	250S												

NOTE: For shipments to U.S. territories, SCWA must be specified to comply with EISA.

Options				Finish ¹⁶				Lamp ¹⁸			
Shipped installed in fixture		EC	Emergency circuit ¹¹	Shipped separately¹²		(blank)	Dark bronze	DNAXD	Natural aluminum	LPI	Lamp included
PER	NEMA twist-lock receptacle only (no photocontrol)	CSA	CSA Certified	PE1	NEMA twist-lock PE (120, 208, 240V)	DWH	White	DWHXD	White	L/LP	Less lamp
SF	Single fuse (120, 277, 347V) n/a TB ¹⁰	NOM	NOM Certified ⁹	PE3	NEMA twist-lock PE (347V)	DBL	Black	DDBTXD	Textured dark bronze		
DF	Double fuse (208, 240, 480V) n/a TB ¹⁰	INTL	Available for MH probe-start shipping outside the U.S.	PE4	NEMA twist-lock PE (480V)	DNA	Natural aluminum	DBLBXD	Textured black		
QRS	Quartz restrrike system ¹¹	KW1	KiloWatch [®] 120V control relay ¹²	PE7	NEMA twist-lock PE (277V)	CRT	Non-stick protective coating ¹⁷	DNATXD	Textured natural aluminum		
QRSTD	QRS time delay ^{8,11}	KW4	KiloWatch [®] 277V control relay ¹²	SC	Shorting cap for PER option	Super Durable Finishes		DWHGXD	Textured white		
		KW4	KiloWatch [®] 277V control relay ¹²	HS	House side shield (R2, R3) ^{14,15}	DDBXD	Dark bronze				
		REGC1	California Title 20 effective 1/1/2010	VG	Vandal guard ¹⁴	DBLXD	Black				

Accessories: Tenon Mounting Slipfitter						
Number of fixtures:						
Tenon O.D.	One	Two@180°	Two@90° ¹⁹	Three@120°	Three@90° ¹⁹	Four@90° ¹⁹
2-3/8" (6)	T20-190	T20-280	T20-290	T20-320	T20-390	T20-490
2-7/8" (7.3)	T25-190	T25-280	T25-290	T25-320	T25-390	T25-490
4" (10.2)	T35-190	T35-280	T35-290	T35-320	T35-390	T35-490


- Notes**
- These wattages require the REGC1 option to be chosen for shipments into California for Title 20 compliance. 250M REGC1 is not available in 347V or 480V.
 - Use reduced jacketed lamp.
 - Must be ordered with SCWA.
 - These wattages do not comply with California Title 20 regulations.
 - Not available with SCWA.
 - Must specify CWI for use in Canada.
 - Optional multi-tap ballast (120, 208, 240, 277V); (120, 277, 347V in Canada).
 - Consult factory for available wattages.
 - Use 9" arm when two or more luminaires are oriented on a 90° drilling pattern.
 - Must specify voltage. Not available with TB.
 - Maximum allowable wattage lamp included.
 - KiloWatch[®] controls are available only with 250S or 400S.
 - May be ordered as an accessory.
 - Prefix with KSF2 when ordering as an accessory.
 - Available with R2 and R3 distributions only.
 - See www.lithonia.com/archcolors for additional color options.
 - Black finish only.
 - Must be specified.
 - Must use RP09 or RP12.

KSF2 Arm-Mounted Rectilinear Cutoff Lighting

Coefficient of Utilization


Initial Footcandle

KSF2 400M R2 TEST NO: 1193031801P
ISOILLUMINANCE PLOT (Footcandle)




400W pulse start metal halide lamp, rated 38000 lumens. Footcandle values based on 20' mounting height.
Classification: Type II, Short, Full Cutoff

KSF2 400M R3 TEST NO: 1194100501P
ISOILLUMINANCE PLOT (Footcandle)




400W pulse start metal halide lamp, rated 38000 lumens. Footcandle values based on 20' mounting height.
Classification: Type III, Short, Full Cutoff

KSF2 400M R4SC TEST NO: 1193041301P
ISOILLUMINANCE PLOT (Footcandle)




400W pulse start metal halide lamp, rated 38000 lumens. Footcandle values based on 20' mounting height.
Classification: Unclassified (Type IV, Very Short), Full Cutoff

KSF2 400M R4W TEST NO: LTL8509P
ISOILLUMINANCE PLOT (Footcandle)




400W pulse start metal halide lamp, rated 38000 lumens. Footcandle values based on 20' mounting height.
Classification: Type IV, Short, Full Cutoff

KSF2 400M R5S TEST NO: 1193051801P
ISOILLUMINANCE PLOT (Footcandle)




400W pulse start metal halide lamp, rated 38000 lumens. Footcandle values based on 20' mounting height.
Classification: Unclassified (Type IV, Very Short), Full Cutoff

KSF2 400S R2 Test No. 1193031601
COEFFICIENT OF UTILIZATION




400W High Pressure Sodium lamp, 50000 rated lumens. Footcandle values based on 35' mounting height, Distribution II, cutoff.

KSF2 400S R3 Test No. TEST NO. 1194091501
COEFFICIENT OF UTILIZATION




400W High Pressure Sodium lamp, rated lumens. Footcandle values based on 35' mounting height, Distribution III, cutoff.

KSF2 400S R4SC Test No. 1193042201
COEFFICIENT OF UTILIZATION




400W High Pressure Sodium lamp, 50000 rated lumens. Footcandle values based on 35' mounting height, Distribution IV, sharp cutoff.

KSF2 400S R4W Test No. LTL8506
COEFFICIENT OF UTILIZATION



400W High Pressure Sodium lamp, 50000 rated lumens. Footcandle values based on 20' mounting height, Distribution IV wide, froward throw.

KSF2 400S R5S Test No. 1193051704
COEFFICIENT OF UTILIZATION



400W High Pressure Sodium lamp, 50000 rated lumens. Footcandle values based on 35' mounting height, Distribution V, cutoff.

Mounting Height Correction Factor

(Multiply the fc level by the correction factor)

35' mounting height	20' mounting height
15 ft. = 5.4	15 ft. = 1.78
30 ft. = 1.36	30 ft. = 0.45
40 ft. = 0.77	40 ft. = 0.25

$$\left(\frac{\text{Existing Mounting Height}}{\text{New Mounting Height}} \right)^2 = \text{Correction Factor}$$

NOTES:

- 1 Photometric data for other distributions can be accessed from the Lithonia Lighting website. (www.Lithonia.com)
- 2 For electrical characteristics, consult outdoor technical data specification sheets on www.Lithonia.com.
- 3 Tested to current IES and NEMA standards under stabilized laboratory conditions. Various operating factors can cause differences between laboratory and actual field measurements. Dimensions and specifications are based on the most current available data and are subject to change.



KSF2-M-S

Appendix E



HanmiGlobal Partner



2014 4 4



2014 4 6

Appendix F



HanmiGlobal Partner

Memorandum



808 SW Third Avenue, Suite 300
Portland, OR 97204
Phone (503) 287-6825
Fax (503) 415-2304

To: Brett Kelper (City of Milwaukie - Planning)
Philip Kolb (City of Milwaukie – Engineering)

From: Troy Kent, PE (Otak)
Matt Klym, EIT (Otak)

Copies: Pete Miller (Otak), Jerry Offer (Otak)

Date: April 22, 2014

Subject: MODA Plaza Parking Preliminary Stormwater
Management

Project No.: Otak Project No. 17134

This memo has been prepared to identify the preliminary stormwater management of the proposed improvement conditions for the MODA Plaza Parking improvements. According to the City of Milwaukie (COM) Public Works Standards, Milwaukie has adopted the City of Portland's (COP) Stormwater Management Manual (SWMM). According to the SWMM section 1.3.2 "Flow and Volume Control" sub-section "Flow Control Exemptions" "New development and redevelopment projects may be exempt from flow control requirements if they discharge stormwater runoff directly into the Willamette River..." Since the project discharges directly to Johnson Creek in close proximity (+/- 400 ft) from the Willamette River, we assume that no flow control is needed for the proposed improvements. Pollution reduction must still be met regardless of exemption of flow control.


Pollution reduction for the MODA Plaza Parking will be met by using two Stormwater Management Stormfilter Catch Basins (as approved by the COP, per "Approved Proprietary Stormwater Treatment Technologies"). The Catch Basin serving Area A (see Exhibit EX-01) will consist of a one cartridge catch basin with a sloped, solid cover located in the southeast portion of the improvements. This catch basin will be serving the existing ditch flow for SE Riverview (private), which had been previously picked up by a culvert and treated by a swale on the MODA property. This swale will be impacted with the proposed improvements and will no longer be able to function as intended. The existing flow will be intercepted in the ditch by a proposed ditch inlet and conveyed to the stormwater catch basin. The second Catch Basin serving the parking lot (Area B) will consist of a two cartridge catch basin with a sloped, vaned inlet grate located in the northeast portion of the improvements. The stormwater will be conveyed by a 12" PVC pipe to an existing rip rap pad in the northeast section of the property.

To size the pollution reduction, the City of Portland's Presumptive Approach Calculator ver 1.2 was used (see attached exhibits A and B). The pollution reduction flow for Area A is $Q_{prA} = 0.024$ CFS and for Area B is $Q_{prB} = 0.063$ CFS. Using a cartridge flow rate of 15 GPM (or 0.033 CFS) for each catch basin, Area A would require one cartridge and Area B would require two cartridges. See attached details for Contech Stormwater Catch Basins.

For conveyance per the City of Portland's Sewer and Drainage Facilities Design Manual (SDFDM), the return period for designing a ditch inlet is 25 years and for a street inlet is 10 years (see Table 6.1 in the SDFDM). For conveyance calculations, please see EX-01. The total flow for Area A is 1.02 CFS and Area B is 0.96 CFS. The total flow for conveyance is 1.98 CFS. The capacity of the 12" PVC pipe with a minimum slope of 1% is 4.54 CFS (see Exhibit C), thus providing adequate capacity for the required design peak flows.

As shown, the treatment and conveyance for the MODA Plaza Parking improvements meet or exceed the design requirements set forth in the City of Portland's Stormwater Management Manual and the Sewer and Drainage Facilities Design Manual.

XREF LIST
 Ltscale: 1
 Resolved
 ParkL3A
 S246B190
 A246s102_50504
 D246X230
 A246X385
 D246X190
 A246XBDR
 RGTSTAMP
 P17134X001
 P17134X230
 P17134X600
 D246X600
 ---Images---
 HCA zones

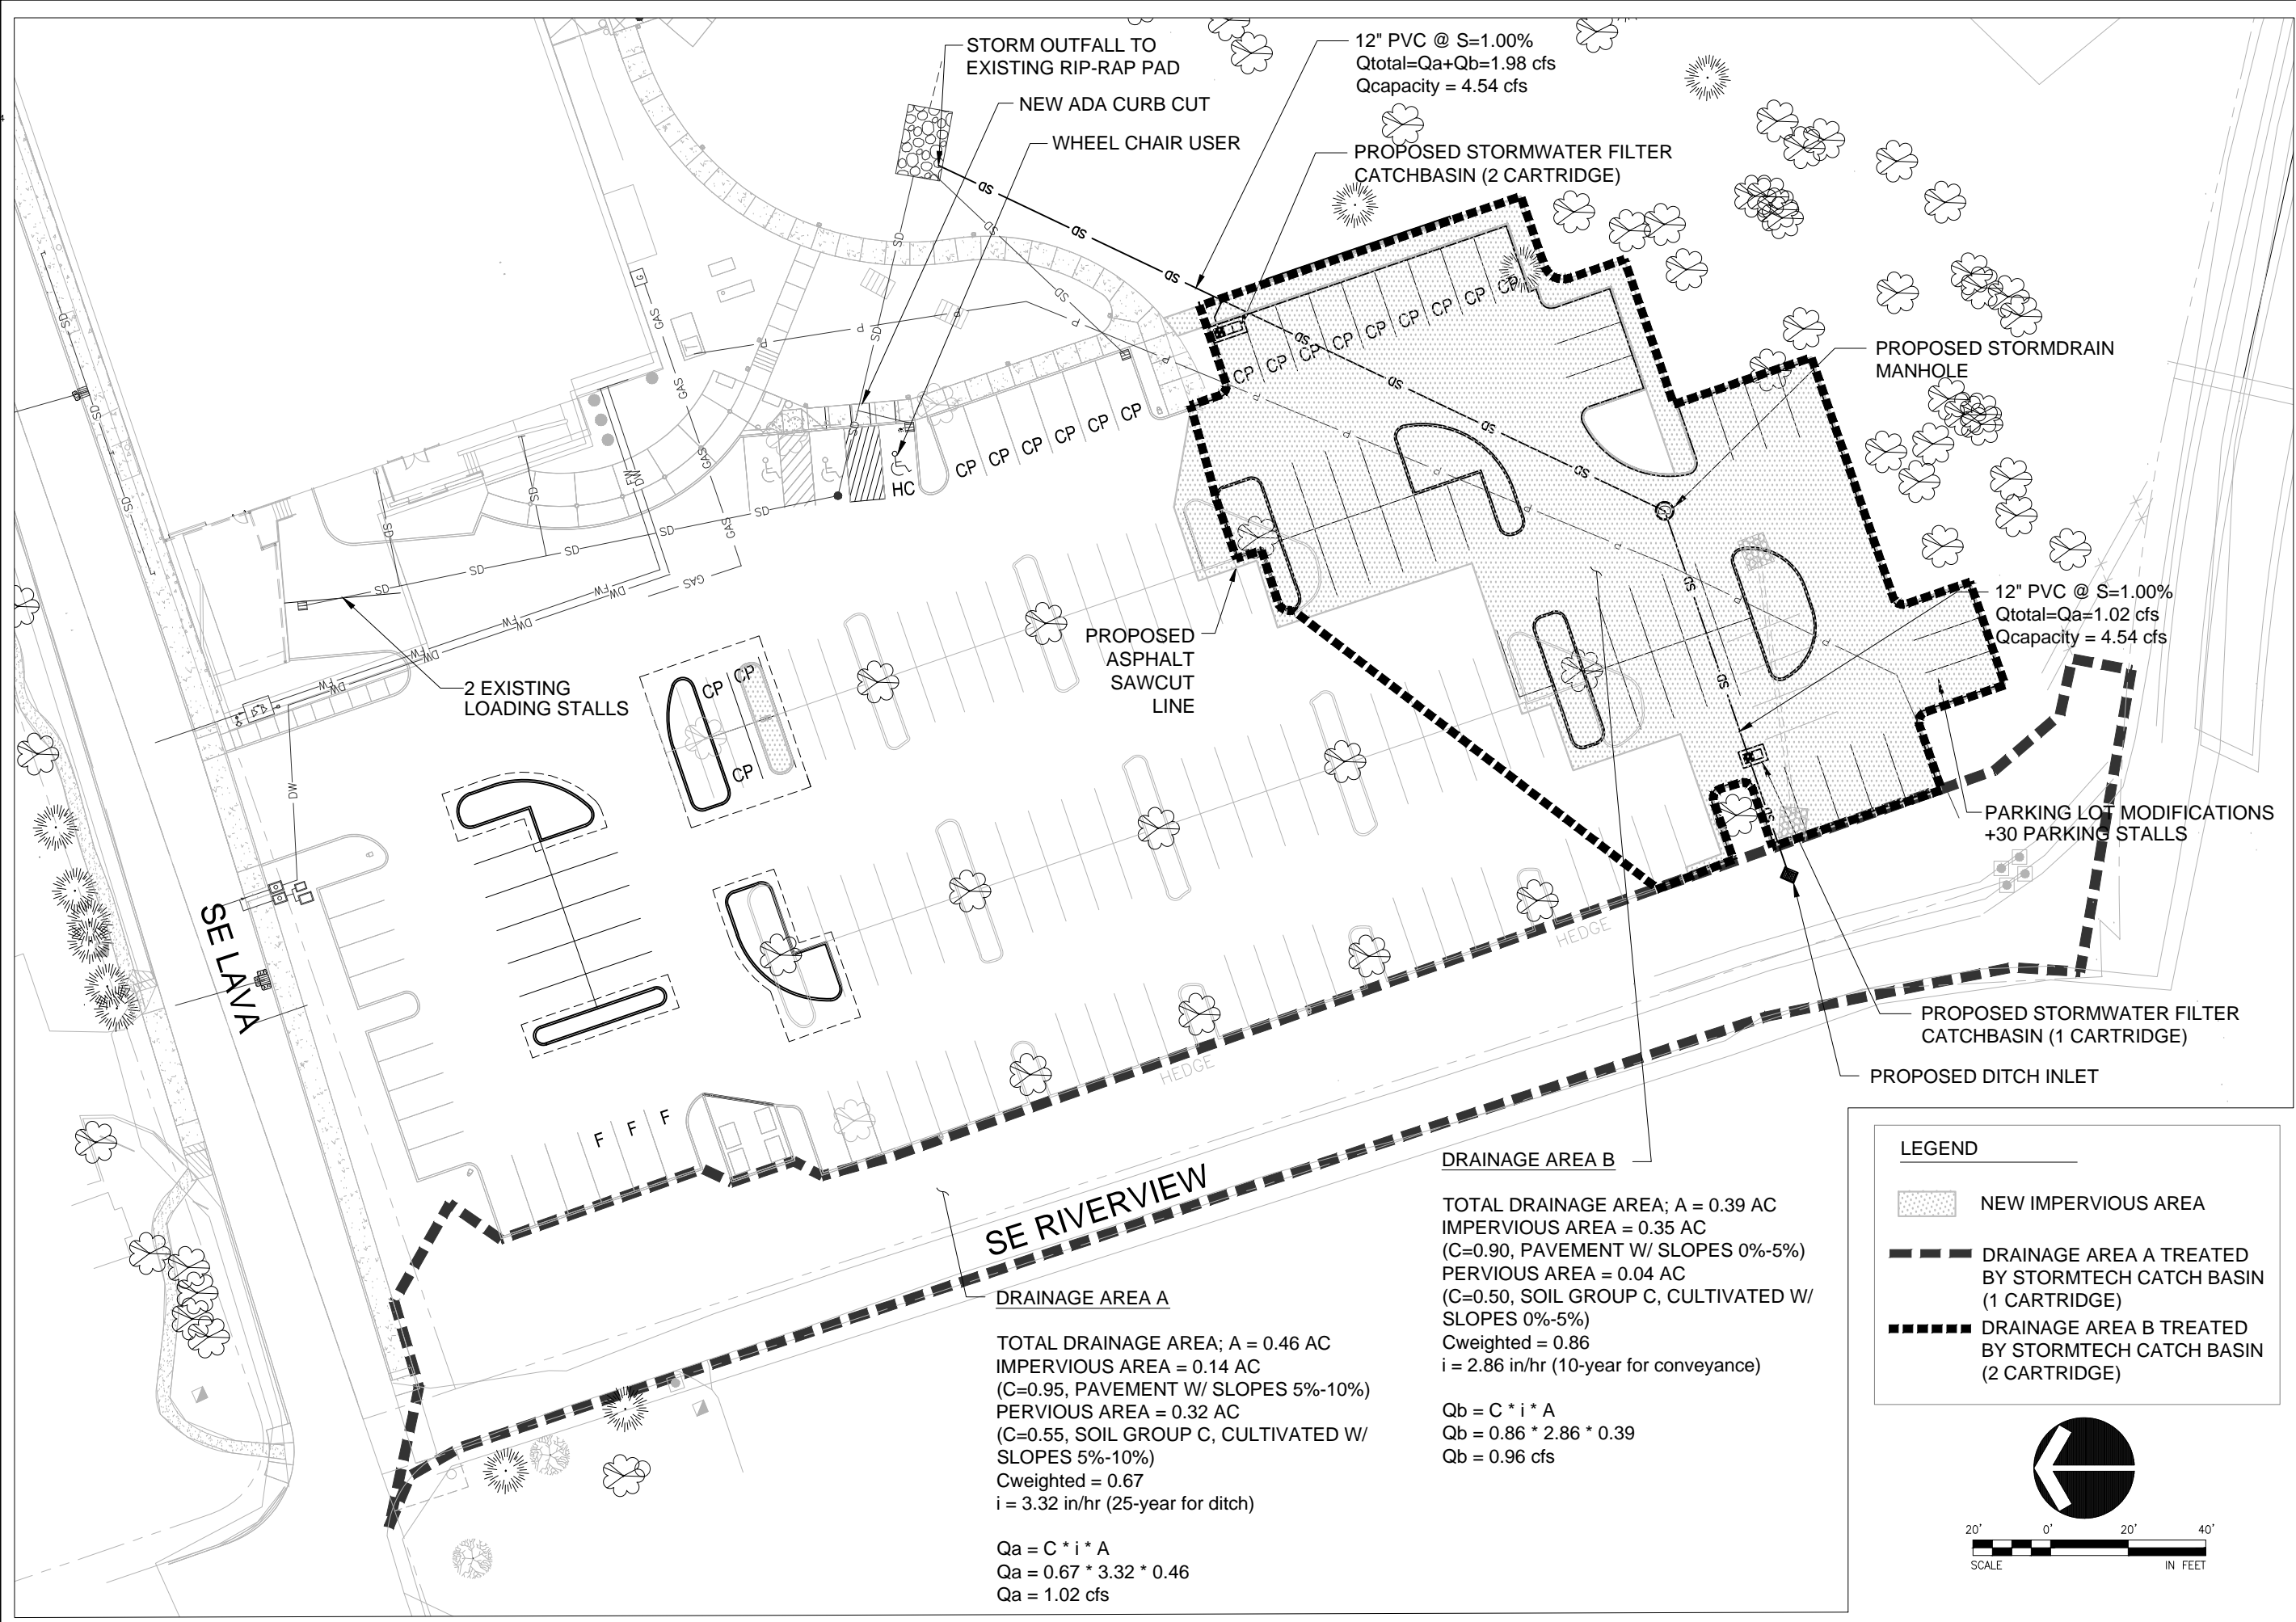

DRAINAGE AREA A

TOTAL DRAINAGE AREA; A = 0.46 AC
 IMPERVIOUS AREA = 0.14 AC
 (C=0.95, PAVEMENT W/ SLOPES 5%-10%)
 PERVIOUS AREA = 0.32 AC
 (C=0.55, SOIL GROUP C, CULTIVATED W/
 SLOPES 5%-10%)
 Cweighted = 0.67
 i = 3.32 in/hr (25-year for ditch)

$Q_a = C * i * A$
 $Q_a = 0.67 * 3.32 * 0.46$
 $Q_a = 1.02 \text{ cfs}$


DRAINAGE AREA B

TOTAL DRAINAGE AREA; A = 0.39 AC
 IMPERVIOUS AREA = 0.35 AC
 (C=0.90, PAVEMENT W/ SLOPES 0%-5%)
 PERVIOUS AREA = 0.04 AC
 (C=0.50, SOIL GROUP C, CULTIVATED W/
 SLOPES 0%-5%)
 Cweighted = 0.86
 i = 2.86 in/hr (10-year for conveyance)

$Q_b = C * i * A$
 $Q_b = 0.86 * 2.86 * 0.39$
 $Q_b = 0.96 \text{ cfs}$

LEGEND

- NEW IMPERVIOUS AREA
- DRAINAGE AREA A TREATED BY STORMTECH CATCH BASIN (1 CARTRIDGE)
- DRAINAGE AREA B TREATED BY STORMTECH CATCH BASIN (2 CARTRIDGE)

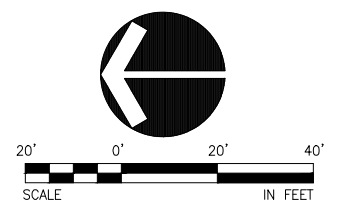

DOWNTOWN DESIGN REVIEW SUBMITTAL - APRIL 10, 2014

MODA HEALTH PLAZA PARKING
 CITY OF MILWAUKIE, OREGON
 NEW IMPERVIOUS AREA

otak
 HammiGlobal Partner
 808 SW 3rd Ave., Ste. 300
 Portland, OR 97204
 Phone: (503) 287-6825
 Fax: (503) 415-2304
 www.otak.com

17134
 Project No. Drawing No.
EX-01
 Sheet No.
 © Otak, Inc. 2014

NO.	DATE	BY	REVISION COMMENTS

Design	Drawn	Checked	Date	Initial Issue Date:
MPK	KNY	TDK		



Presumptive Approach Calculator ver. 1.2

Catchment Data

Project Name: MODA Plaza Parking
 Project Address: City of Milwaukie

Catchment ID: A

Date: 04/21/14

Permit Number: _____

Designer: Matt Klym
 Company: OTAK, Inc.

Run Time 5/12/2010 8:41:09 AM

Drainage Catchment Information

Catchment ID	A	
	Catchment Area	
Impervious Area	5,926	SF
Impervious Area	0.14	ac
Impervious Area Curve Number, CN_{imp}	98	
Time of Concentration, T_c , minutes	5	min.

Site Soils & Infiltration Testing Data

Infiltration Testing Procedure:	Open Pit Falling Head	
Native Soil Field Tested Infiltration Rate (I_{test}):	1	in/hr
Bottom of Facility Meets Required Separation From High Groundwater Per BES SWMM Section 1.4:	Yes	

Correction Factor Component


CF_{test} (ranges from 1 to 3)	2
----------------------------------	---

Design Infiltration Rates

I_{dsgn} for Native (I_{test} / CF_{test}):	0.50	in/hr
I_{dsgn} for Imported Growing Medium:	2.00	in/hr

Execute SBUH Calculations

SBUH Results

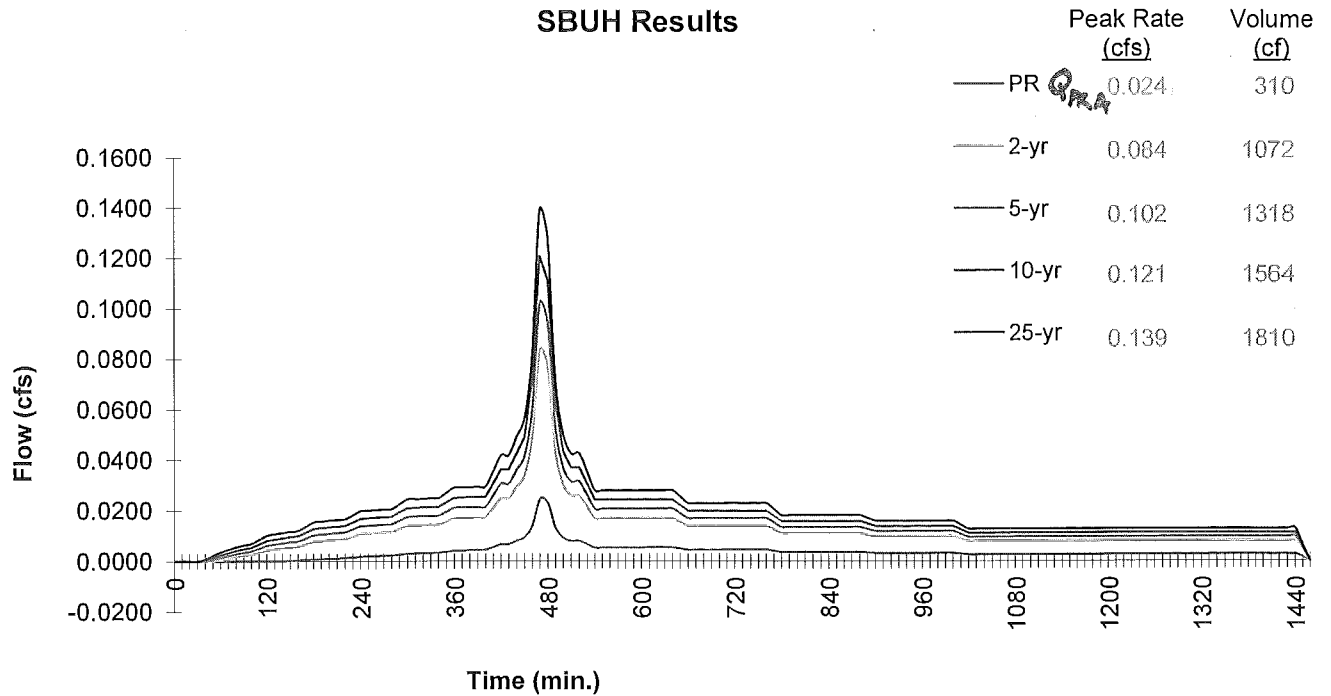



Presumptive Approach Calculator ver. 1.2

Catchment Data

Project Name: MODA Plaza Parking
 Project Address: City of Milwaukie

Catchment ID: B

Date: 04/21/14


Permit Number: _____

Designer: Matt Klym
 Company: OTAK, Inc.

Run Time 5/12/2010 8:41:09 AM

Drainage Catchment Information	
Catchment ID	B
Catchment Area	
Impervious Area	15,295 SF
Impervious Area	0.35 ac
Impervious Area Curve Number, CN_{imp}	98
Time of Concentration, T_c , minutes	5 min.
Site Soils & Infiltration Testing Data	
Infiltration Testing Procedure:	Open Pit Falling Head
Native Soil Field Tested Infiltration Rate (I_{test}):	1 in/hr
Bottom of Facility Meets Required Separation From High Groundwater Per BES SWMM Section 1.4:	Yes
Correction Factor Component	
CF_{test} (ranges from 1 to 3)	2
Design Infiltration Rates	
I_{dsgn} for Native (I_{test} / CF_{test}):	0.50 in/hr
I_{dsgn} for Imported Growing Medium:	2.00 in/hr

Execute SBUH Calculations

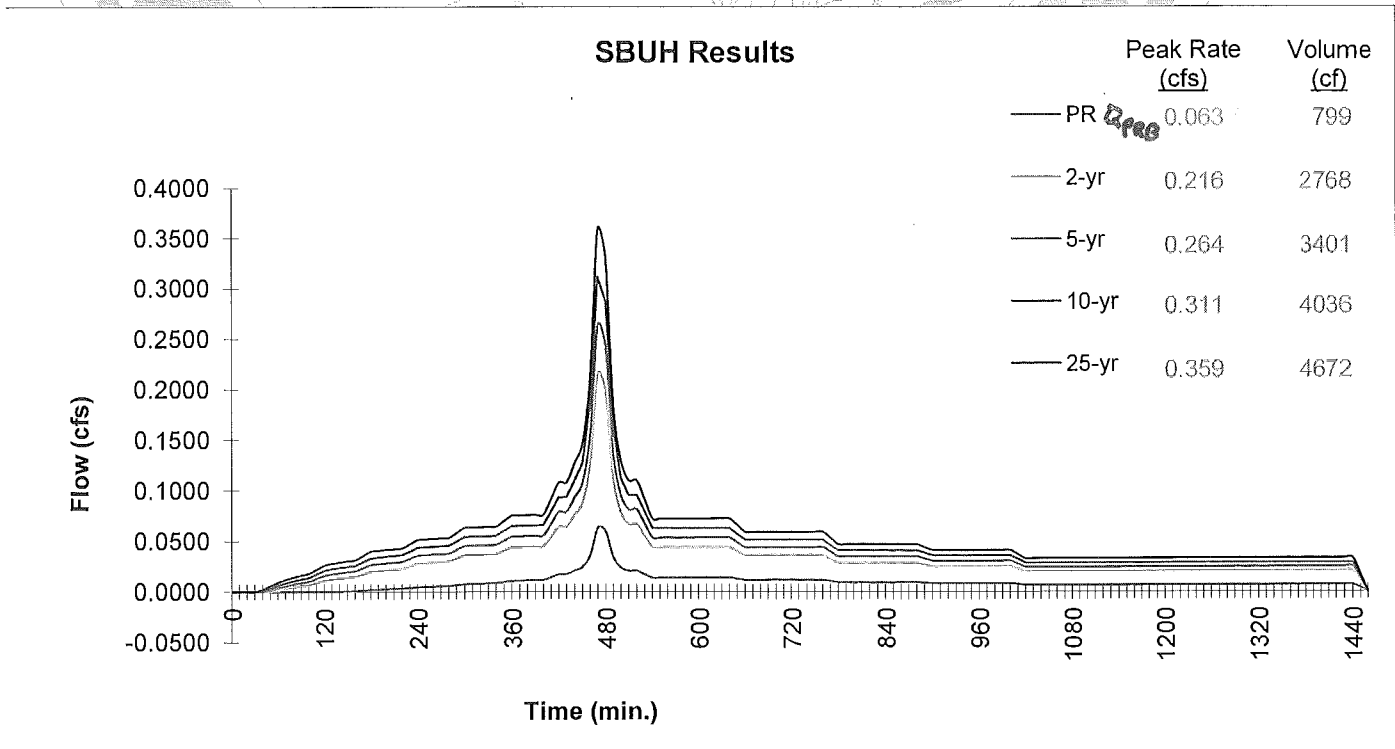

Matt Klym


Matt Klym 13:29 21-Apr-14

Project 17134

MODA

GRAVITY PIPE FLOW (Chezy-Manning)

Main Pipe

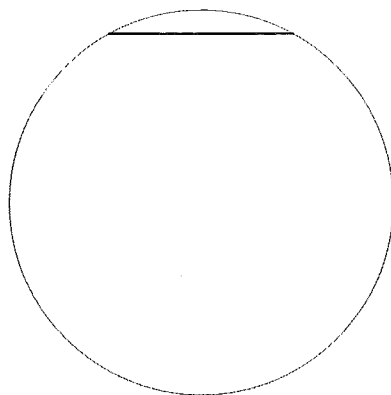

□ 2"

diameter = 12.0"

slope = 1.00%

material: ABS, PVC

Manning's n = 0.011

depth of flow = 93.82% of diameter (max)

wetted perimeter = 2.64'

area = 0.77 s.f.

hydraulic radius = 0.29'

velocity = 5.93 fps

flow = 4.54 cfs

STORMFILTER CATCHBASIN DESIGN NOTES

STORMFILTER TREATMENT CAPACITY IS A FUNCTION OF THE CARTRIDGE SELECTION AND THE NUMBER OF CARTRIDGES. 1 CARTRIDGE CATCHBASIN HAS A MAXIMUM OF ONE CARTRIDGE. SYSTEM IS SHOWN WITH A 27" CARTRIDGE, AND IS ALSO AVAILABLE WITH AN 18" CARTRIDGE. STORMFILTER CATCHBASIN CONFIGURATIONS ARE AVAILABLE WITH A DRY INLET BAY FOR VECTOR CONTROL. PEAK HYDRAULIC CAPACITY PER TABLE BELOW. IF THE SITE CONDITIONS EXCEED PEAK HYDRAULIC CAPACITY, AN UPSTREAM BYPASS STRUCTURE IS REQUIRED.

CARTRIDGE SELECTION


CARTRIDGE HEIGHT	27"		18"		18" DEEP	
MINIMUM HYDRAULIC DROP (H)	3.05'		2.3'		3.3'	
SPECIFIC FLOW RATE (gpm/sf)	2 gpm/ft ²	1 gpm/ft ²	2 gpm/ft ²	1 gpm/ft ²	2 gpm/ft ²	1 gpm/ft ²
CARTRIDGE FLOW RATE (gpm)	22.5	11.25	15	7.5	15	7.5
PEAK HYDRAULIC CAPACITY	1.0		1.0		1.8	
INLET PERMANENT POOL LEVEL (A)	1'-0"		1'-0"		2'-0"	
OVERALL STRUCTURE HEIGHT (B)	4'-9"		3'-9"		4'-9"	

GENERAL NOTES


- CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
- FOR SITE SPECIFIC DRAWINGS WITH DETAILED STORMFILTER CATCHBASIN STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. www.ContechES.com
- STORMFILTER CATCHBASIN WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
- INLET SHOULD NOT BE LOWER THAN OUTLET. INLET (IF APPLICABLE) AND OUTLET PIPING TO BE SPECIFIED BY ENGINEER AND PROVIDED BY CONTRACTOR.
- STORMFILTER CATCHBASIN EQUIPPED WITH 4 INCH (APPROXIMATE) LONG STUBS FOR INLET (IF APPLICABLE) AND OUTLET PIPING. STANDARD OUTLET STUB IS 8 INCHES IN DIAMETER. MAXIMUM OUTLET STUB IS 15 INCHES IN DIAMETER. CONNECTION TO COLLECTION PIPING CAN BE MADE USING FLEXIBLE COUPLING BY CONTRACTOR.
- STEEL STRUCTURE TO BE MANUFACTURED OF 1/4 INCH STEEL PLATE. CASTINGS SHALL MEET AASHTO M306 LOAD RATING. TO MEET HS20 LOAD RATING ON STRUCTURE, A CONCRETE COLLAR IS REQUIRED. WHEN REQUIRED, CONCRETE COLLAR WITH QUANTITY (2) #4 REINFORCING BARS TO BE PROVIDED BY CONTRACTOR.
- FILTER CARTRIDGES SHALL BE MEDIA-FILLED, PASSIVE, SIPHON ACTUATED, RADIAL FLOW, AND SELF CLEANING. RADIAL MEDIA DEPTH SHALL BE 7-INCHES. FILTER MEDIA CONTACT TIME SHALL BE AT LEAST 37 SECONDS.
- SPECIFIC FLOW RATE IS EQUAL TO THE FILTER TREATMENT CAPACITY (gpm) DIVIDED BY THE FILTER CONTACT SURFACE AREA (sq ft).

INSTALLATION NOTES


- ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CATCHBASIN (LIFTING CLUTCHES PROVIDED).
- CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.

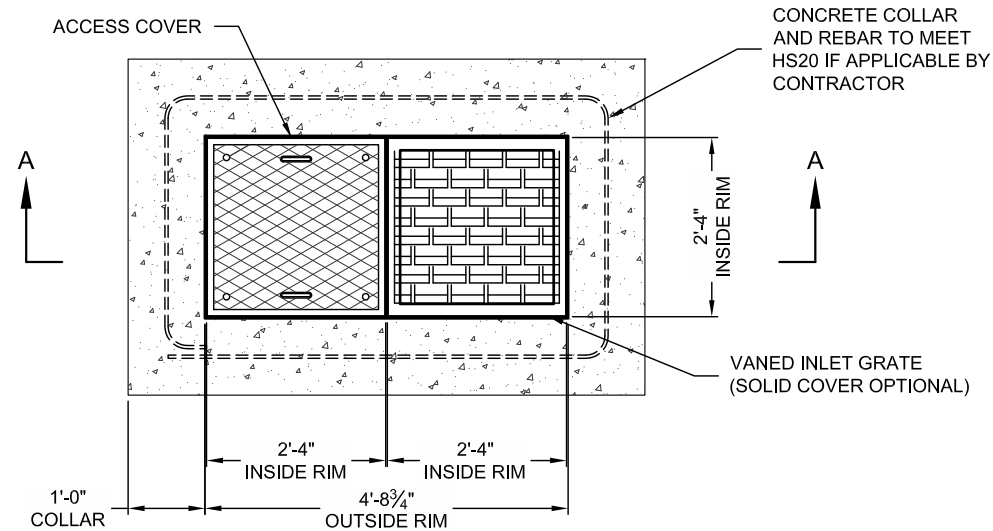

PLAN VIEW

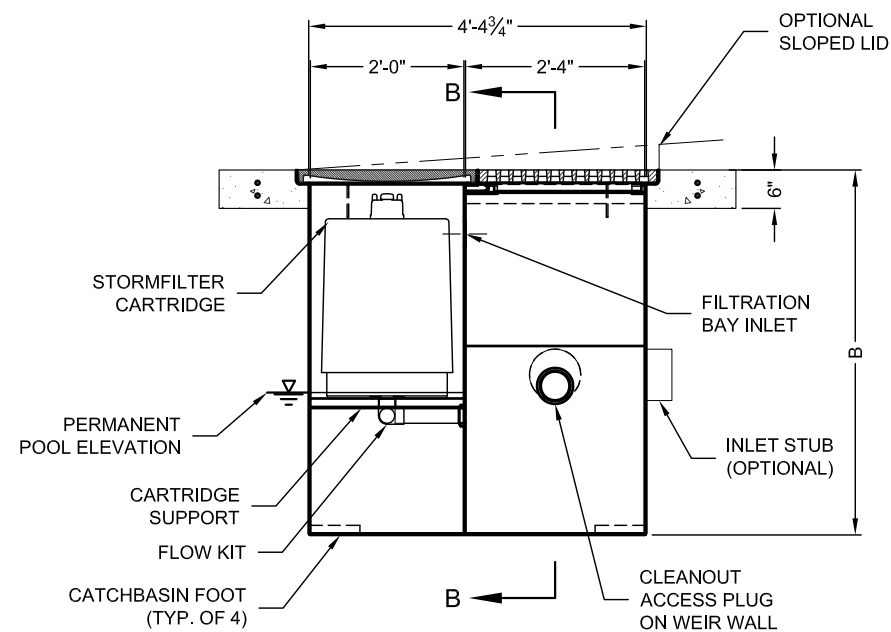

SECTION A-A

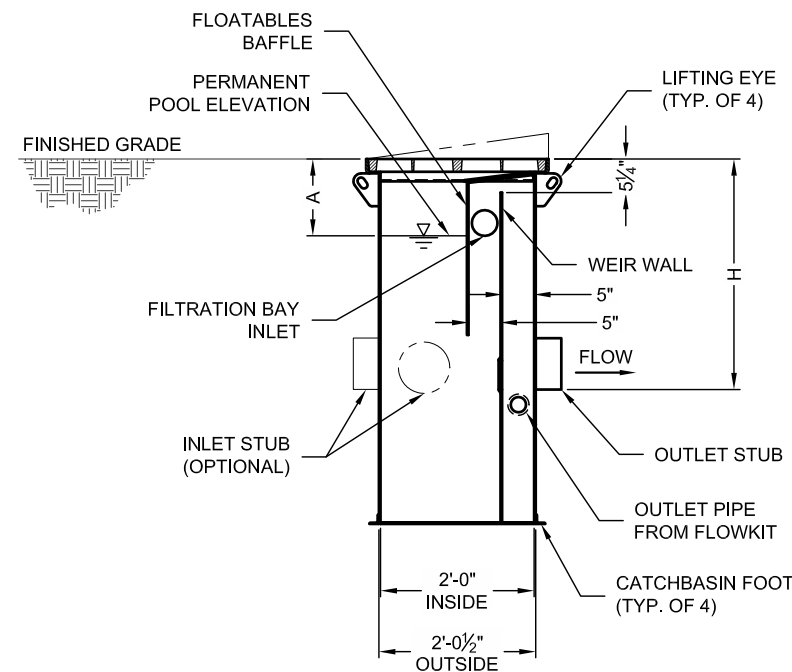

SECTION B-B

1-CARTRIDGE CATCHBASIN STORMFILTER DATA	
STRUCTURE ID	XXX
WATER QUALITY FLOW RATE (cfs)	X.XX
PEAK FLOW RATE (<1 cfs)	X.XX
RETURN PERIOD OF PEAK FLOW (yrs)	XXX
CARTRIDGE FLOW RATE (gpm)	XX
MEDIA TYPE (CSF, PERLITE, ZPG, GAC, PHS)	XXXXX
RIM ELEVATION	XXX.XX'
PIPE DATA:	I.E. DIAMETER
INLET STUB	XXX.XX' XX"
OUTLET STUB	XXX.XX' XX"
CONFIGURATION	
SLOPED LID	YES/NO
SOLID COVER	YES/NO
NOTES/SPECIAL REQUIREMENTS:	

STORMFILTER CATCHBASIN DESIGN NOTES

STORMFILTER TREATMENT CAPACITY IS A FUNCTION OF THE CARTRIDGE SELECTION AND THE NUMBER OF CARTRIDGES. 2 CARTRIDGE CATCHBASIN HAS A MAXIMUM OF TWO CARTRIDGES. SYSTEM IS SHOWN WITH A 27" CARTRIDGE, AND IS ALSO AVAILABLE WITH AN 18" CARTRIDGE. STORMFILTER CATCHBASIN CONFIGURATIONS ARE AVAILABLE WITH A DRY INLET BAY FOR VECTOR CONTROL. PEAK HYDRAULIC CAPACITY PER TABLE BELOW. IF THE SITE CONDITIONS EXCEED PEAK HYDRAULIC CAPACITY, AN UPSTREAM BYPASS STRUCTURE IS REQUIRED.

CARTRIDGE SELECTION


CARTRIDGE HEIGHT	27"		18"		18" DEEP	
MINIMUM HYDRAULIC DROP (H)	3.05'		2.3'		3.3'	
SPECIFIC FLOW RATE (gpm/sf)	2 gpm/ft ²	1 gpm/ft ²	2 gpm/ft ²	1 gpm/ft ²	2 gpm/ft ²	1 gpm/ft ²
CARTRIDGE FLOW RATE (gpm)	22.5	11.25	15	7.5	15	7.5
PEAK HYDRAULIC CAPACITY	1.0		1.0		1.8	
INLET PERMANENT POOL LEVEL (A)	1'-0"		1'-0"		2'-0"	
OVERALL STRUCTURE HEIGHT (B)	4'-9"		3'-9"		4'-9"	

GENERAL NOTES


- CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
- FOR SITE SPECIFIC DRAWINGS WITH DETAILED STORMFILTER CATCHBASIN STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. www.ContechES.com
- STORMFILTER CATCHBASIN WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
- INLET SHOULD NOT BE LOWER THAN OUTLET. INLET (IF APPLICABLE) AND OUTLET PIPING TO BE SPECIFIED BY ENGINEER AND PROVIDED BY CONTRACTOR.
- STORMFILTER CATCHBASIN EQUIPPED WITH 4 INCH (APPROXIMATE) LONG STUBS FOR INLET (IF APPLICABLE) AND OUTLET PIPING. STANDARD OUTLET STUB IS 8 INCHES IN DIAMETER. MAXIMUM OUTLET STUB IS 15 INCHES IN DIAMETER. CONNECTION TO COLLECTION PIPING CAN BE MADE USING FLEXIBLE COUPLING BY CONTRACTOR.
- STEEL STRUCTURE TO BE MANUFACTURED OF 1/4 INCH STEEL PLATE. CASTINGS SHALL MEET AASHTO M306 LOAD RATING. TO MEET HS20 LOAD RATING ON STRUCTURE, A CONCRETE COLLAR IS REQUIRED. WHEN REQUIRED, CONCRETE COLLAR WITH QUANTITY (2) #4 REINFORCING BARS TO BE PROVIDED BY CONTRACTOR.
- FILTER CARTRIDGES SHALL BE MEDIA-FILLED, PASSIVE, SIPHON ACTUATED, RADIAL FLOW, AND SELF CLEANING. RADIAL MEDIA DEPTH SHALL BE 7-INCHES. FILTER MEDIA CONTACT TIME SHALL BE AT LEAST 37 SECONDS.
- SPECIFIC FLOW RATE IS EQUAL TO THE FILTER TREATMENT CAPACITY (gpm) DIVIDED BY THE FILTER CONTACT SURFACE AREA (sq ft).

INSTALLATION NOTES


- ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CATCHBASIN (LIFTING CLUTCHES PROVIDED).
- CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.

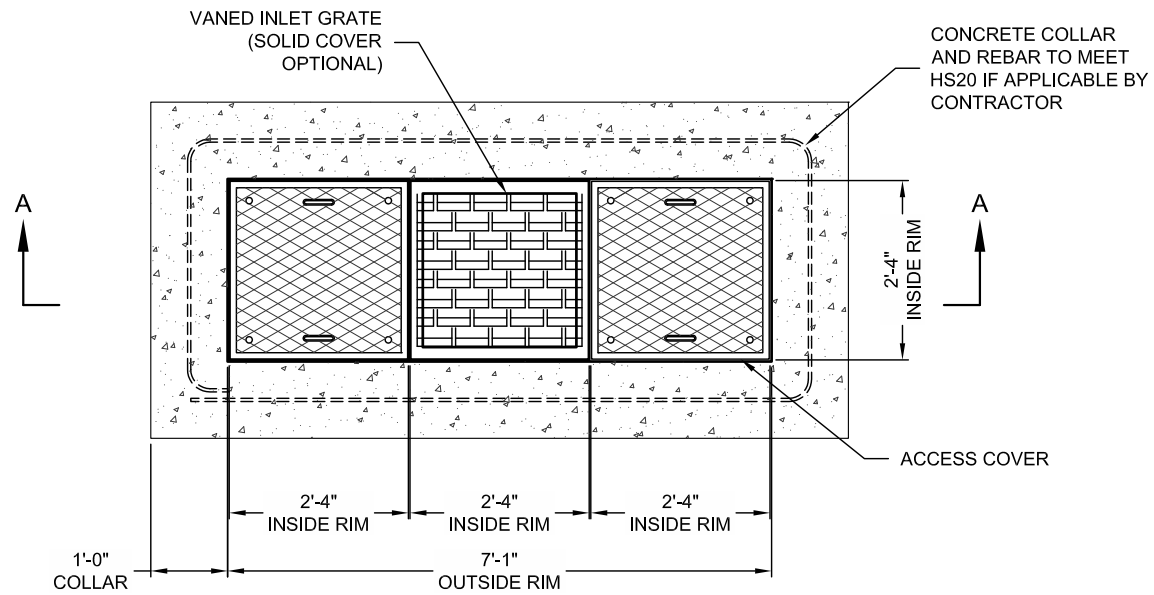

PLAN VIEW

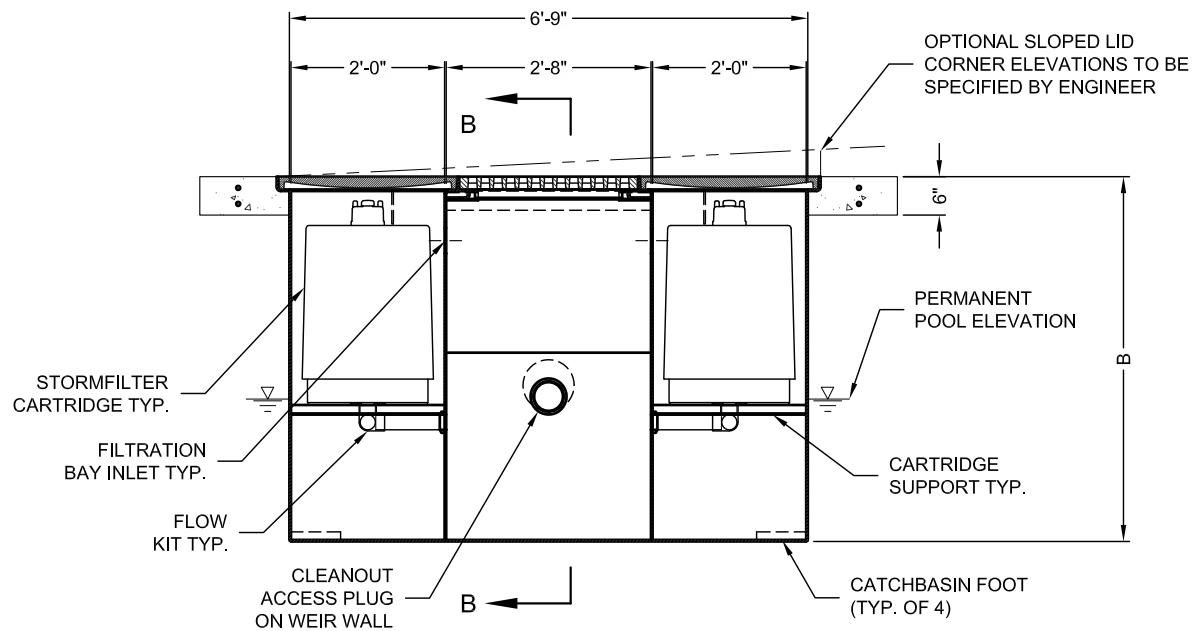

SECTION A-A

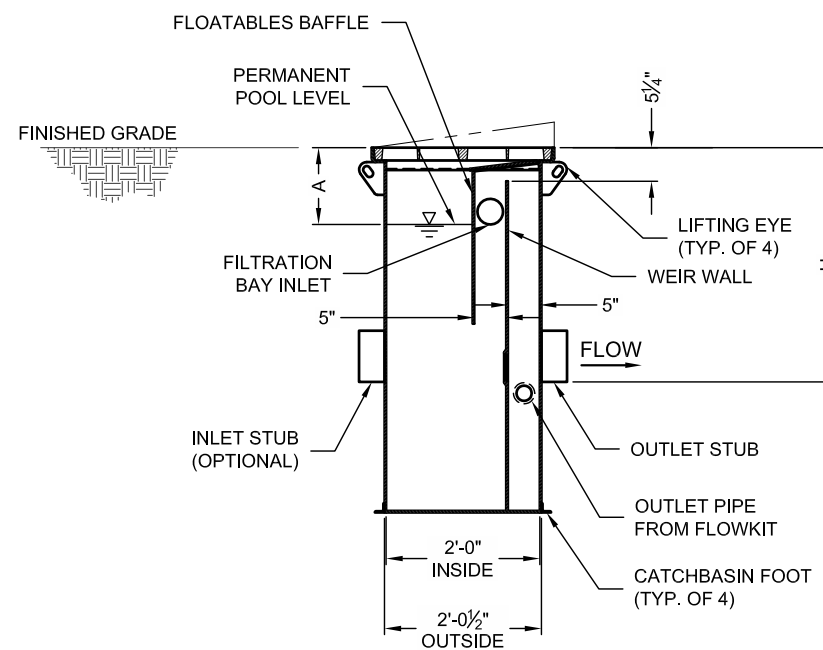


SECTION B-B

2-CARTRIDGE DEEP CATCHBASIN STORMFILTER DATA

STRUCTURE ID	XXX
WATER QUALITY FLOW RATE (cfs)	X.XX
PEAK FLOW RATE (<1.8 cfs)	X.XX
RETURN PERIOD OF PEAK FLOW (yrs)	XXX
CARTRIDGE FLOW RATE (gpm)	XX
MEDIA TYPE (CSF, PERLITE, ZPG, GAC, PHS)	XXXXX
RIM ELEVATION	XXX.XX'

PIPE DATA:	I.E.	DIAMETER
INLET STUB	XXX.XX'	XX"
OUTLET STUB	XXX.XX'	XX"

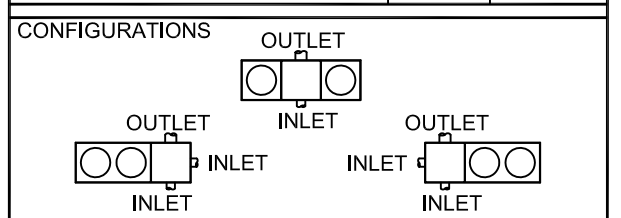

SLOPED LID	YES/NO
SOLID COVER	YES/NO

NOTES/SPECIAL REQUIREMENTS:

Plan Set



HanmiGlobal Partner

XREF LIST
 Ltscale: 1
 Resolved
 ParkL3A
 S246B190
 A246s102_50504
 D246X230
 A246X385
 D246X190
 A246XBDR
 RGTSTAMP
 P17134X001
 ---Images---
 ge n
 VICINITY MAP

MODA HEALTH PLAZA PARKING

WESTERN PARKING LOT EXPANSION

CLACKAMAS COUNTY, OREGON

OWNER/APPLICANT


NAME: MODA HEALTH
 CONTACT: DAVID SHAPPER
 ADDRESS: 601 SW 2ND AVE
 PORTLAND, OR 97204-3156
 PHONE: (503) 948-5564
 EMAIL: david.shaffer@modahealth.com

CIVIL ENGINEER/SURVEYOR/PLANNER/ARCHITECT

NAME: OTAK INCORPORATED
 PLANNER: JERRY OFFER
 ENGINEER: TROY KENT, P.E.
 ARCHITECT: PETER MILLER
 ADDRESS: 808 SW THIRD AVENUE, SUITE 300
 PORTLAND, OR 97204
 PHONE: (503) 287-6825
 FAX: (503) 415-2304

SHEET INDEX

- P0.0 COVER SHEET
- P1.0 EXISTING CONDITIONS
- P1.1 OVERALL MODA HEALTH SITE PLAN
- P1.2 WESTERN PARKING LOT SITE PLAN
- P2.0 SITE GRADING AND TREE REMOVAL PLAN
- L1.0 LANDSCAPE PLAN
- L1.1 PLANTING NOTES AND DETAILS

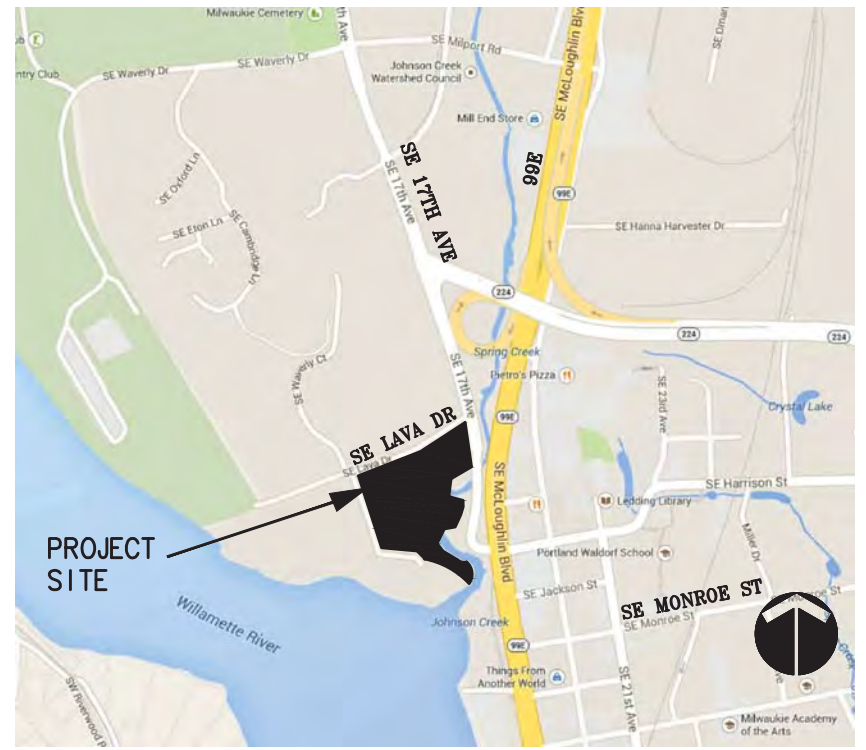

VICINITY MAP
 N.T.S.



PROJECT MAP
 N.T.S.

SITE INFORMATION

CLACKAMAS COUNTY, OREGON
 1S 1E 35AA: TAX LOT 3500
 314,128 SF / 7.21 ACRES

LAND USE RESUBMITTAL - APRIL 25, 2014

MODA HEALTH PLAZA PARKING
 CITY OF MILWAUKIE, OREGON

COVER SHEET



HammiGlobal Partner
 808 SW 3rd Ave., Ste. 300
 Portland, OR 97204
 Phone: (503) 287-6825
 Fax: (503) 415-2304
 www.otak.com

17134 P17134P0.0
 Project No. Drawing No.

P0.0

Sheet No.
 © Otak, Inc. 2014


NO.	DATE	BY	REVISION COMMENTS

Design	Drawn	Checked	Date	Initial Issue Date:
MPK	KY	TDK		

Plotter: Apr 24, 2014 - 10:02am malk L:\Project\17100\17134\DWG\17134P0.0.dwg Layout Name: P0.0


XREF LIST
 Ltscale: 40
 Resolved
 ParkL3A
 S246B190
 A246s102_50504
 D246X230
 A246X385
 D246X190
 A246XBDR
 RGTSTAMP
 P17134X001
 P17134X600
 --Images--
 ge n

Plotter: Apr 24, 2014 - 10:02am matk L:\Project\17100\17134\DWG\17134P1.1.dwg Layout Name: P1.1

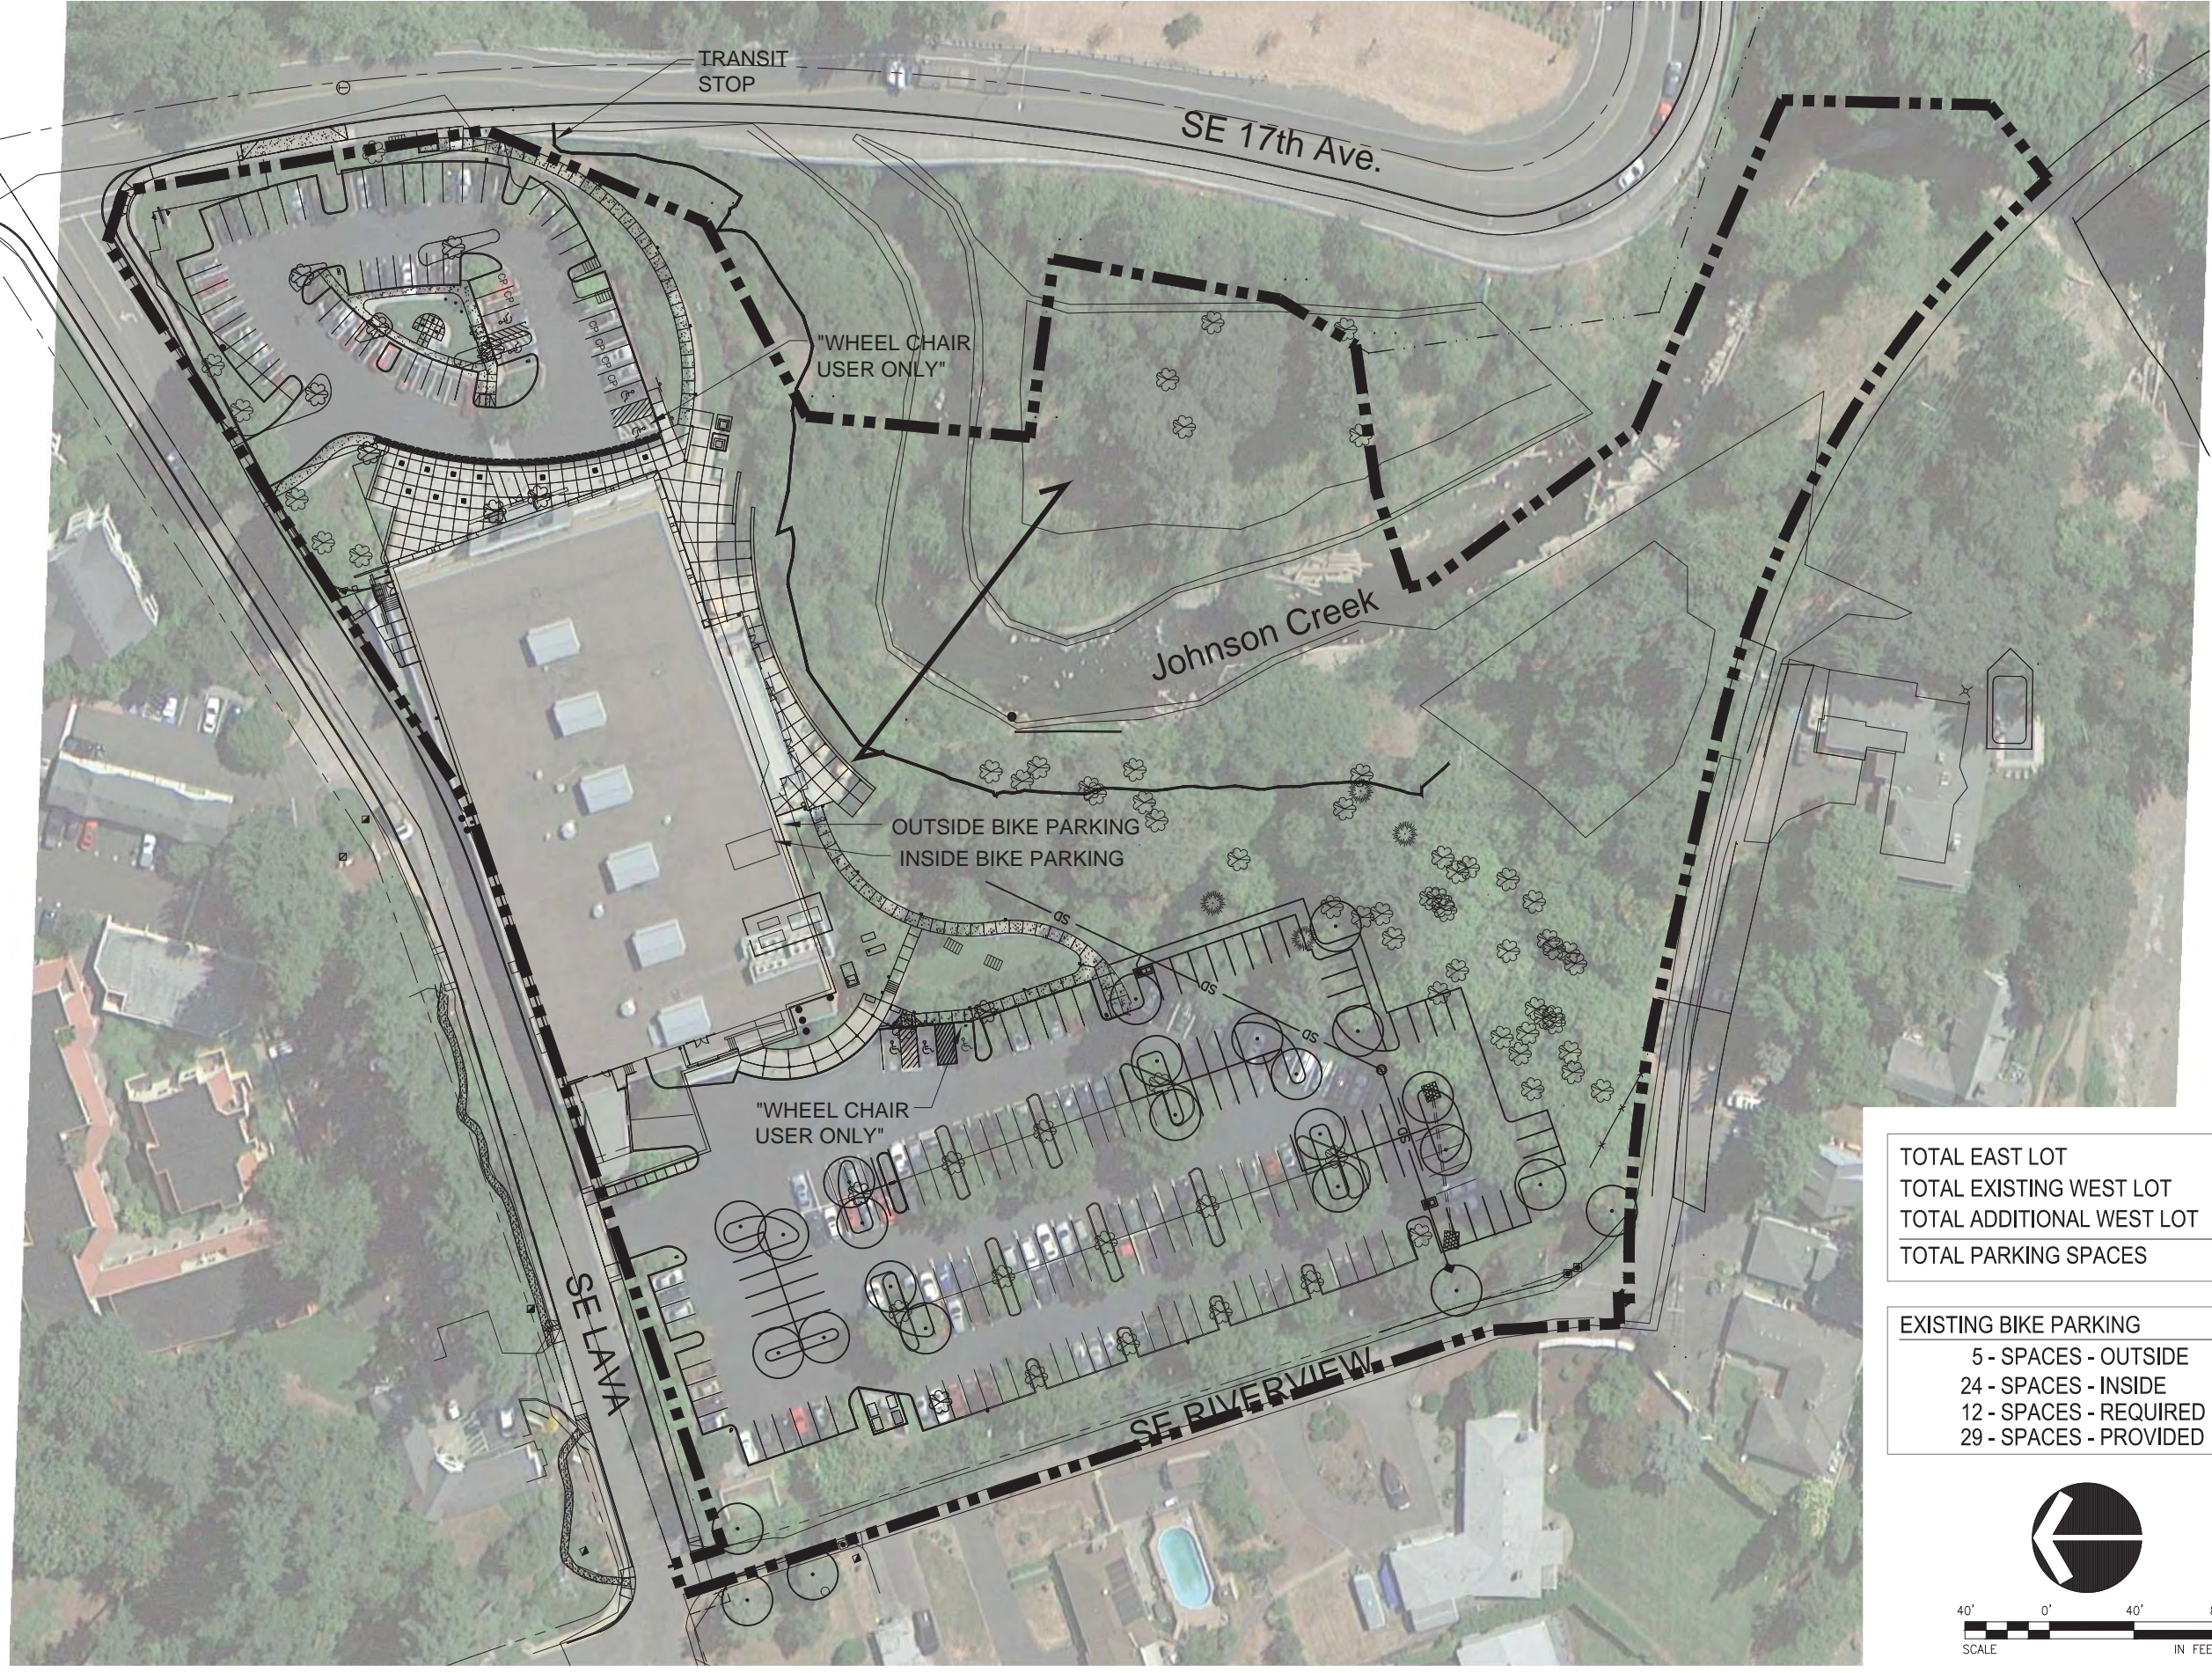

TOTAL EAST LOT	56
TOTAL EXISTING WEST LOT	150
TOTAL ADDITIONAL WEST LOT	30
TOTAL PARKING SPACES	236

EXISTING BIKE PARKING	
5 - SPACES - OUTSIDE	
24 - SPACES - INSIDE	
12 - SPACES - REQUIRED	
29 - SPACES - PROVIDED	

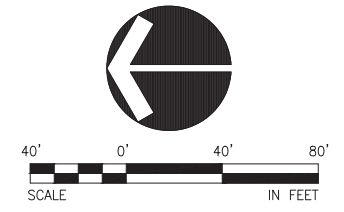

LAND USE RESUBMITTAL - APRIL 25, 2014

MODA HEALTH PLAZA PARKING
 CITY OF MILWAUKIE, OREGON

OVERALL MODA HEALTH SITE PLAN




17134 P17134P1.1
 Project No. Drawing No.
P1.1
 Sheet No.
 © Otak, Inc. 2014

NO.	DATE	BY	REVISION COMMENTS

Design MFRK	Drawn KY	Checked KY	Date	Initial Issue Date:

XREF LIST
 Ltscale: 1
 Resolved
 ParkL3A
 S246B190
 A246s102_50504
 D246X230
 A246X385
 D246X190
 A246XBDR
 RGTSTAMP
 P17134X001
 P17134X230
 P17134X600
 D246X600
 ---Images---
 HCA zones

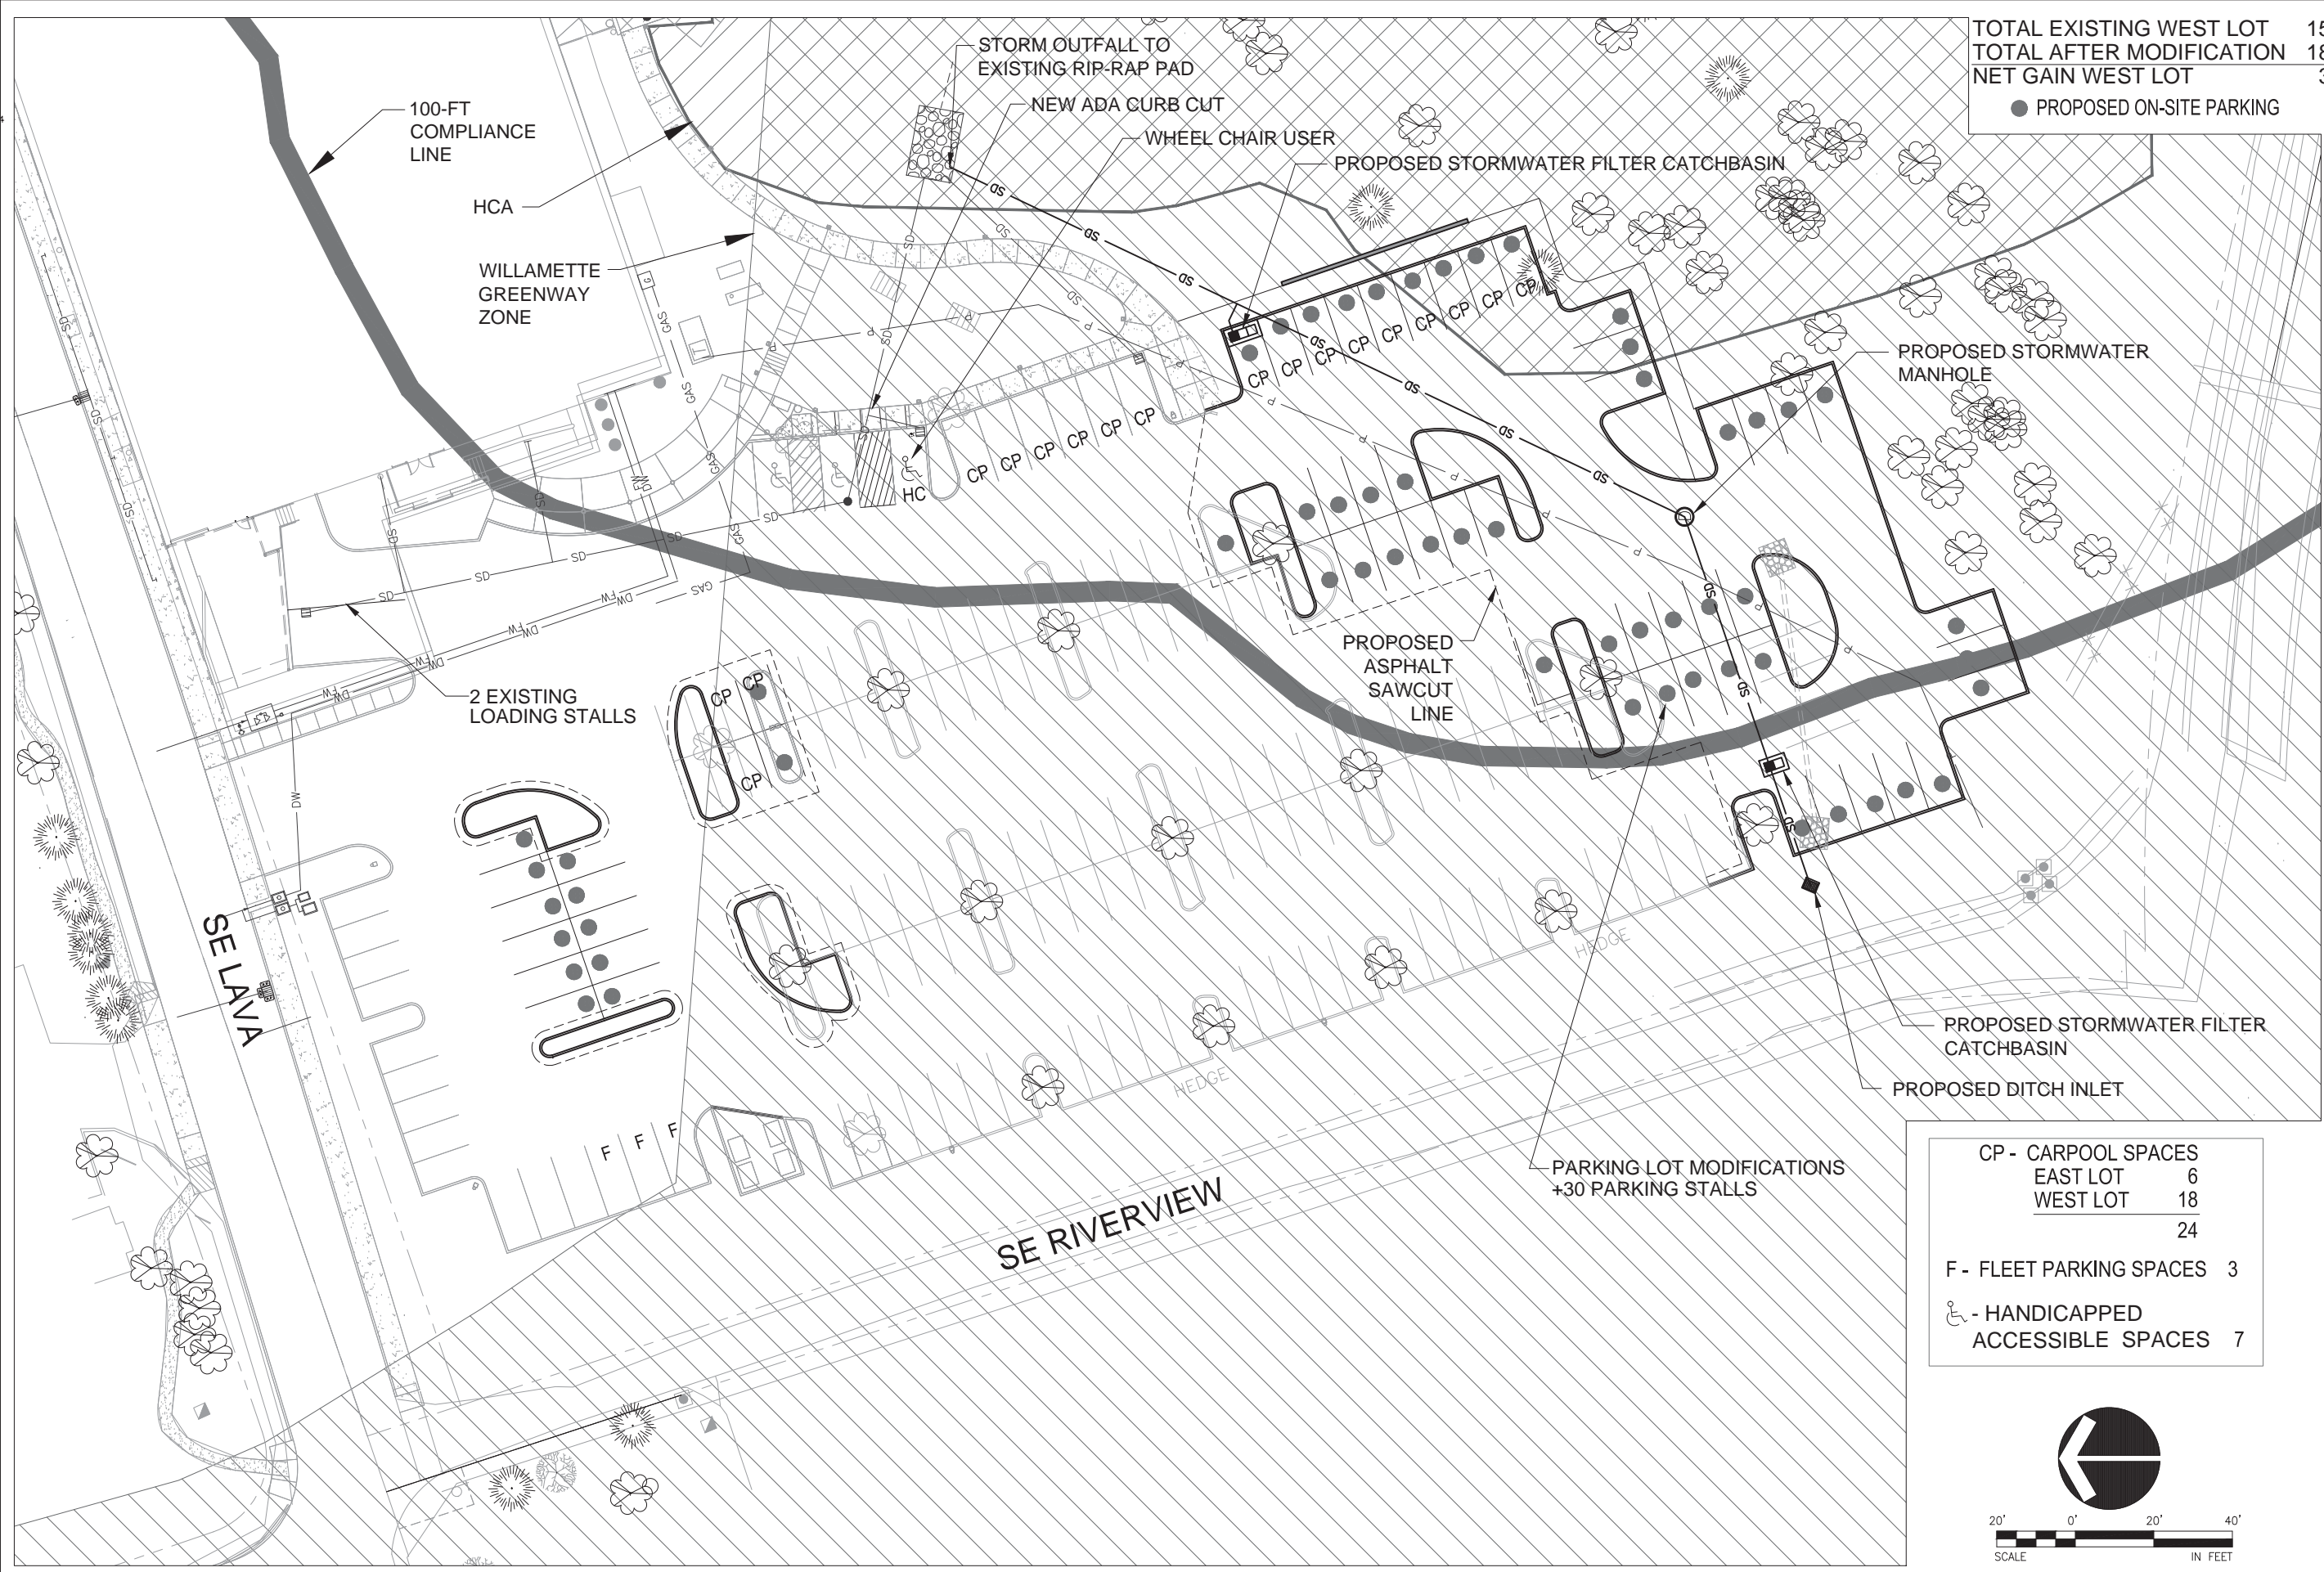


TOTAL EXISTING WEST LOT	150
TOTAL AFTER MODIFICATION	180
NET GAIN WEST LOT	30

● PROPOSED ON-SITE PARKING

CP - CARPOOL SPACES	
EAST LOT	6
WEST LOT	18
	24
F - FLEET PARKING SPACES	3
♿ - HANDICAPPED ACCESSIBLE SPACES	7

PARKING LOT MODIFICATIONS
 +30 PARKING STALLS

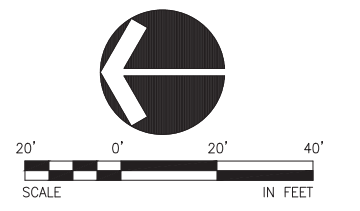

LAND USE RESUBMITTAL - APRIL 25, 2014



MODA HEALTH PLAZA PARKING
 CITY OF MILWAUKIE, OREGON

WESTERN PARKING LOT SITE PLAN

otak
 HummiGlobal Partner
 808 SW 3rd Ave., Ste. 300
 Portland, OR 97204
 Phone: (503) 287-6825
 Fax: (503) 415-2304
 www.otak.com
 17134 P17134P1.2
 Project No. Drawing No.
P1.2
 Sheet No.
 © Otak, Inc. 2014

NO.	DATE	BY	REVISION COMMENTS

Plotter: Apr 24, 2014 - 10:03am mattk L:\Project\17100\17134\DWG\17134P1.2.dwg Layout Name: P1.2

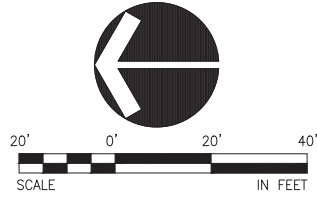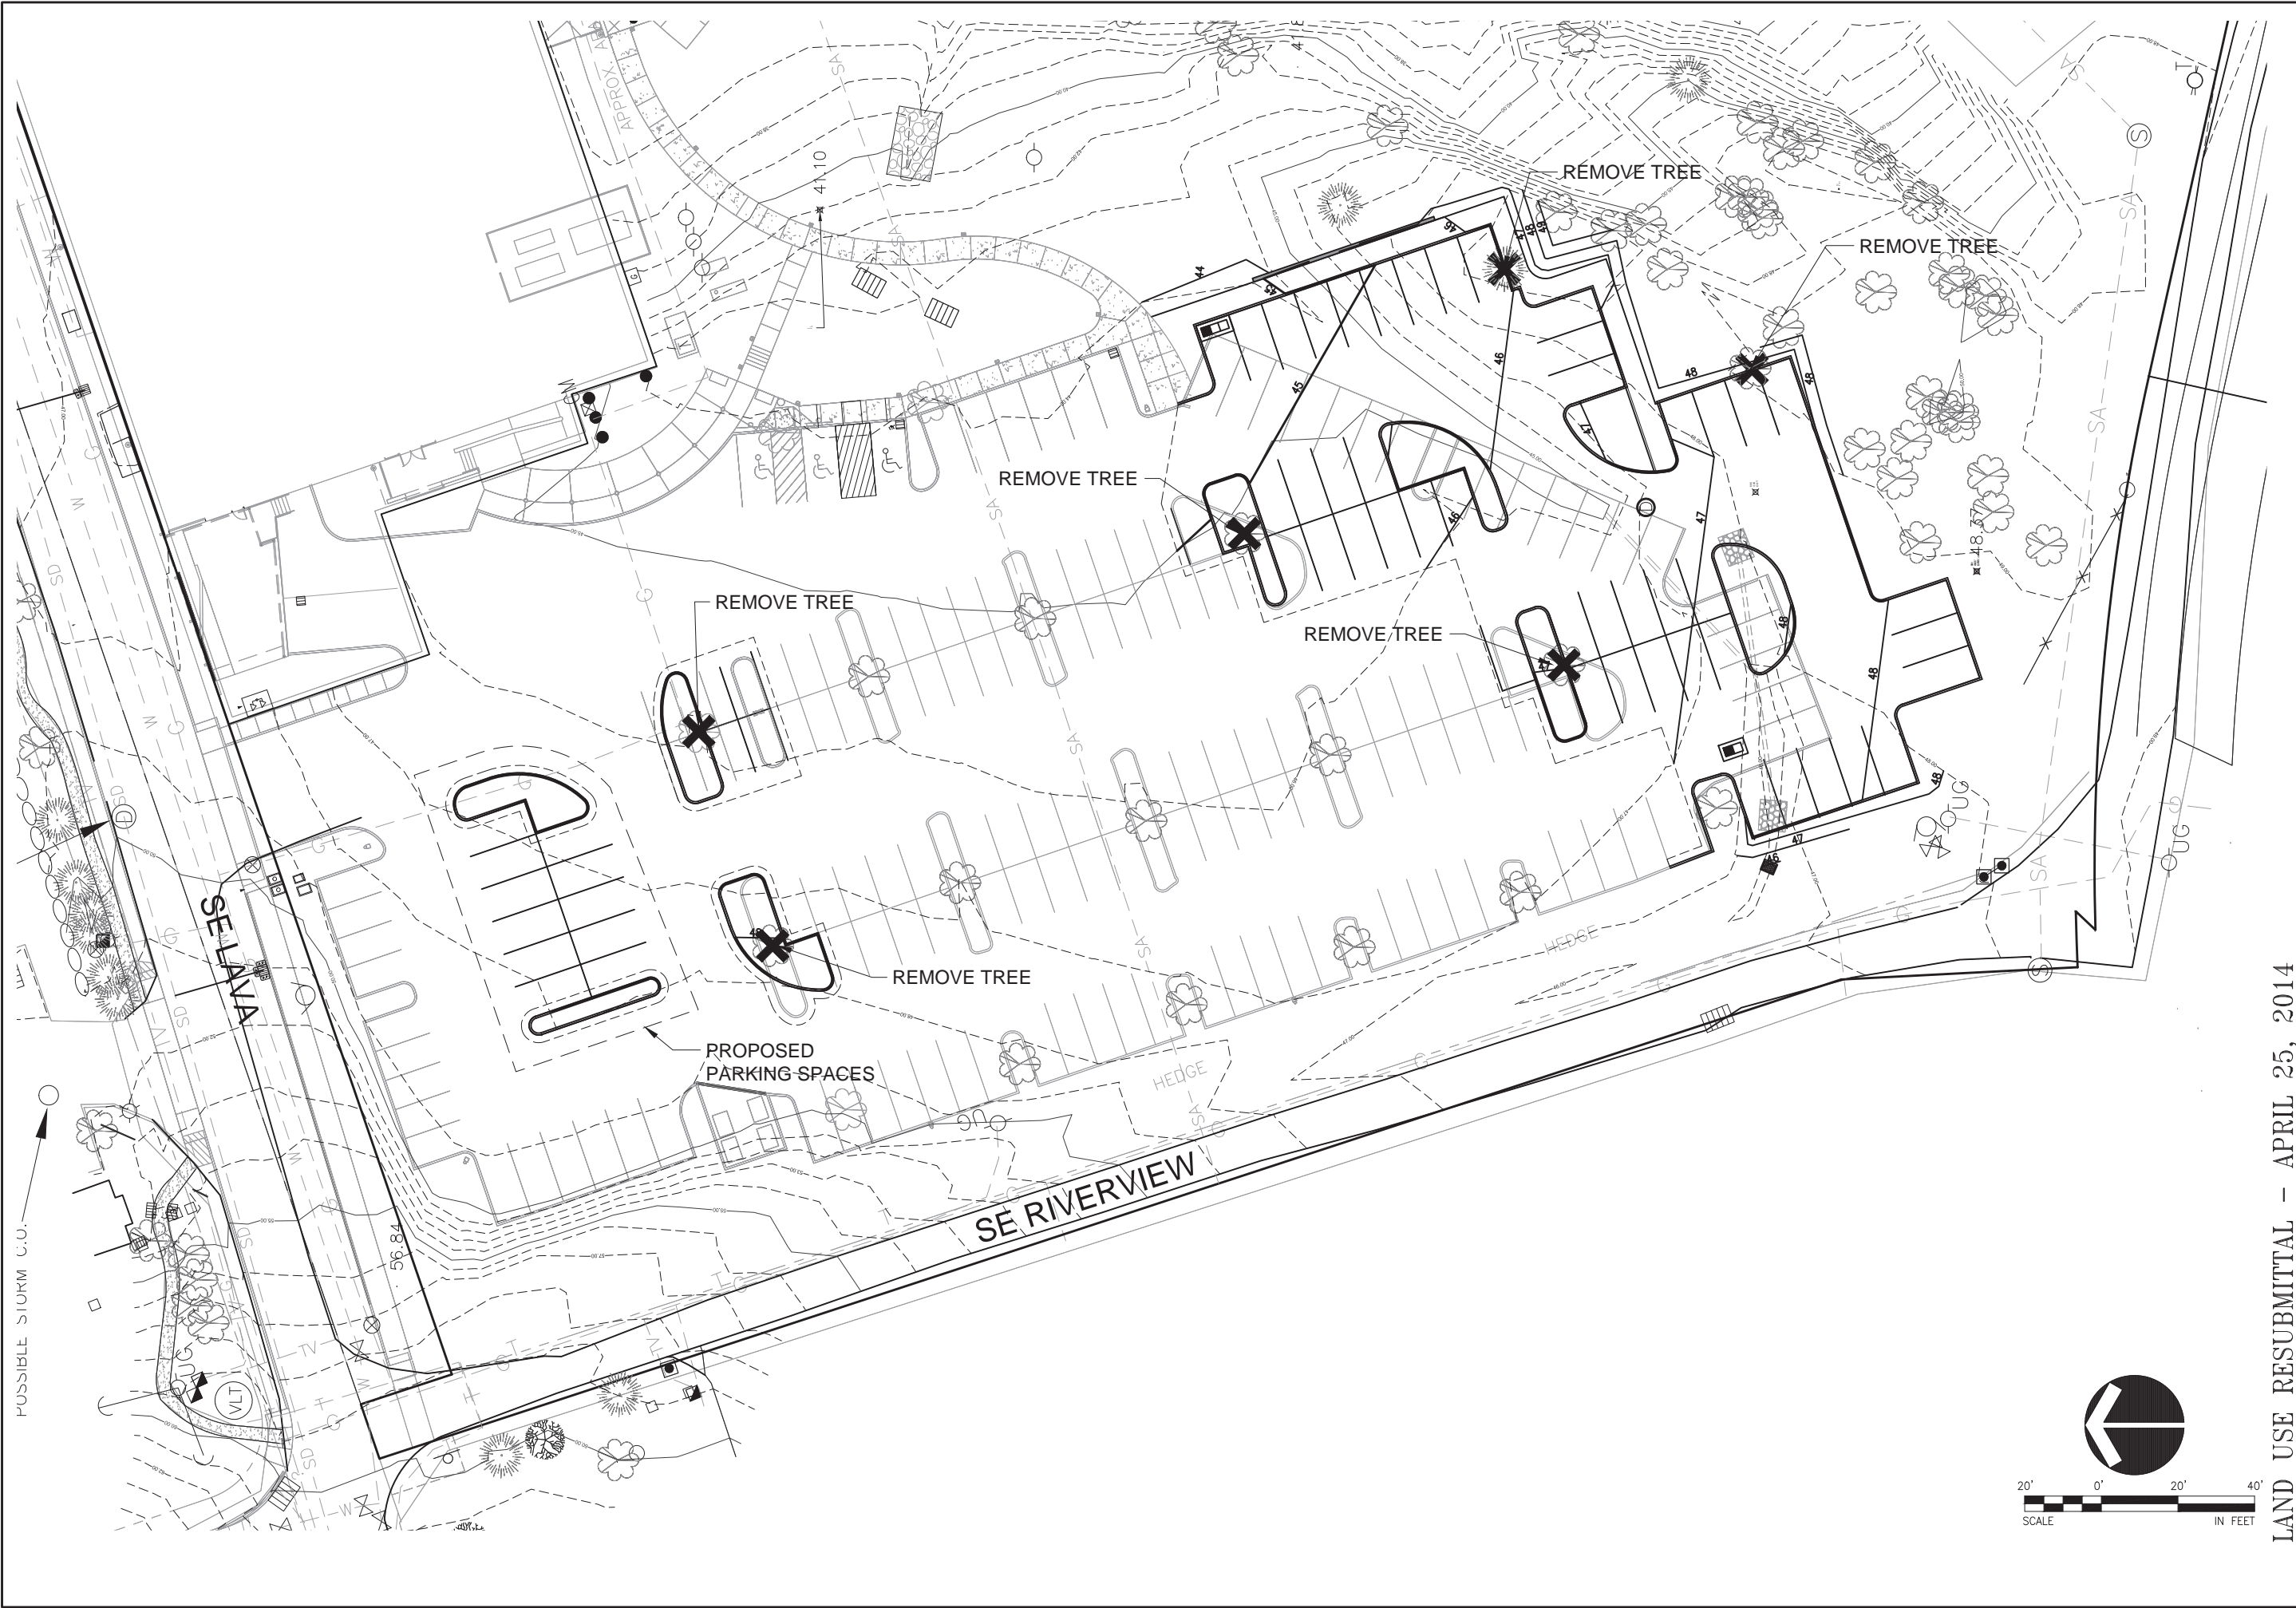

LAND USE RESUBMITTAL - APRIL 25, 2014

MODA HEALTH PLAZA PARKING
CITY OF MILWAUKIE, OREGON

SITE GRADING AND TREE REMOVAL PLAN

otak
HammiGlobal Partner
808 SW 3rd Ave., Ste. 300
Portland, OR 97204
Phone: (503) 287-6825
Fax: (503) 415-2304
www.otak.com

17134 P17134P2.0
Project No. Drawing No.
P2.0
Sheet No.
© Otak, Inc. 2014

NO.	DATE	BY	REVISION COMMENTS

Design	Drawn	Checked	Date	Initial	Issue
MRK	KY	TDK			

Design	Drawn	Checked	Date	Initial	Issue

XREF LIST
 Ltscale: 1
 Resolved
 ParkL3A
 S246B190
 A246s102_50504
 D246X230
 A246X385
 D246X190
 A246XBDR
 RGTSTAMP
 P17134X001
 P17134X230
 P17134X600
 D246X600
 ---Images---
 HCA zones

Plotted: Apr 24, 2014 - 10:57am
 dwdhdh V:\PROJECTS\17100\17134\Draw\P17134P10.dwg Layout Name: L1.0

- LIGHTING LEGEND**
- □ EXISTING SINGLE HEAD POLE LIGHT TO REMAIN
 - ■ SINGLE HEAD POLE LIGHT: LITHONIA LIGHTING KSF2 'SA' METAL HALIDE 400W LAMP. 20 FT. MOUNT HEIGHT.
 - ■ DOUBLE HEAD POLE LIGHT: LITHONIA LIGHTING KSF2 'SA1' METAL HALIDE 400W LAMP PER FIXTURE. 20 FT. MOUNT HEIGHT.

PLANTING LEGEND

TREES


SYMBOL	QUANTITY	COMMON NAME / Botanical name:	Size and Description
	8	EASTERN REDBUD / <i>Cercis canadensis</i> :	2" Cal, B&B*
	8	'HALKA' THORNLESS HONEYLOCUST / <i>Gleditsia triacanthos var. inermis 'Halka'</i>	2" Cal, B&B*
	2	BIG LEAF MAPLE / <i>Acer macrophyllum</i>	2" Cal, B&B*
	2	PONDEROSA PINE / <i>Pinus ponderosa</i>	6'-8' Ht, B&B*

SHRUBS

SYMBOL	QUANTITY	COMMON NAME / Botanical name:	Size and Spacing
	42	RED TWIG DOGWOOD / <i>Cornus sericea</i>	5 Gal, 6' o.c.
	53	TALL OREGON GRAPE / <i>Mahonia aquifolium</i>	5 Gal, 8' o.c.
	26	CALIFORNIA WAX MYRTLE / <i>Myrica californica</i>	5 Gal, 8' o.c.
	95	ZABELIAN ENGLISH LAURELCHERRY / <i>Prunus laurocerasus 'Zabellana'</i>	5 Gal, 4' o.c.
	15	PACIFIC NINEBARK / <i>Physocarpus capitatus</i>	5 Gal, 5' o.c.
	9	SALAL / <i>Gaultheria shallon</i>	2 Gal, 3' o.c.
	32	WESTERN SWORDFERN / <i>Polystichum munitum</i>	2 Gal, 3' o.c.

GROUNDCOVER AND LAWN

SYMBOL	QUANTITY	COMMON NAME / Botanical name:	Size and description
	840	KINKINNICK / <i>Arctostaphylos uva-ursi</i> : 1 GAL. POTS @ 24" O.C.	
	750 S.F.	PRO-TIME 309 (SUPREME MIX) GRASS SEED BY HOBBS AND HOPKINS, LTD. AT A RATE OF 8 LBS/1000 SQUARE FEET.	
	2,765 S.F.	PRO-TIME 400 (NATIVE GRASS MIX) GRASS SEED BY HOBBS AND HOPKINS, LTD. AT A RATE OF 1 LB/1000 S.F.	

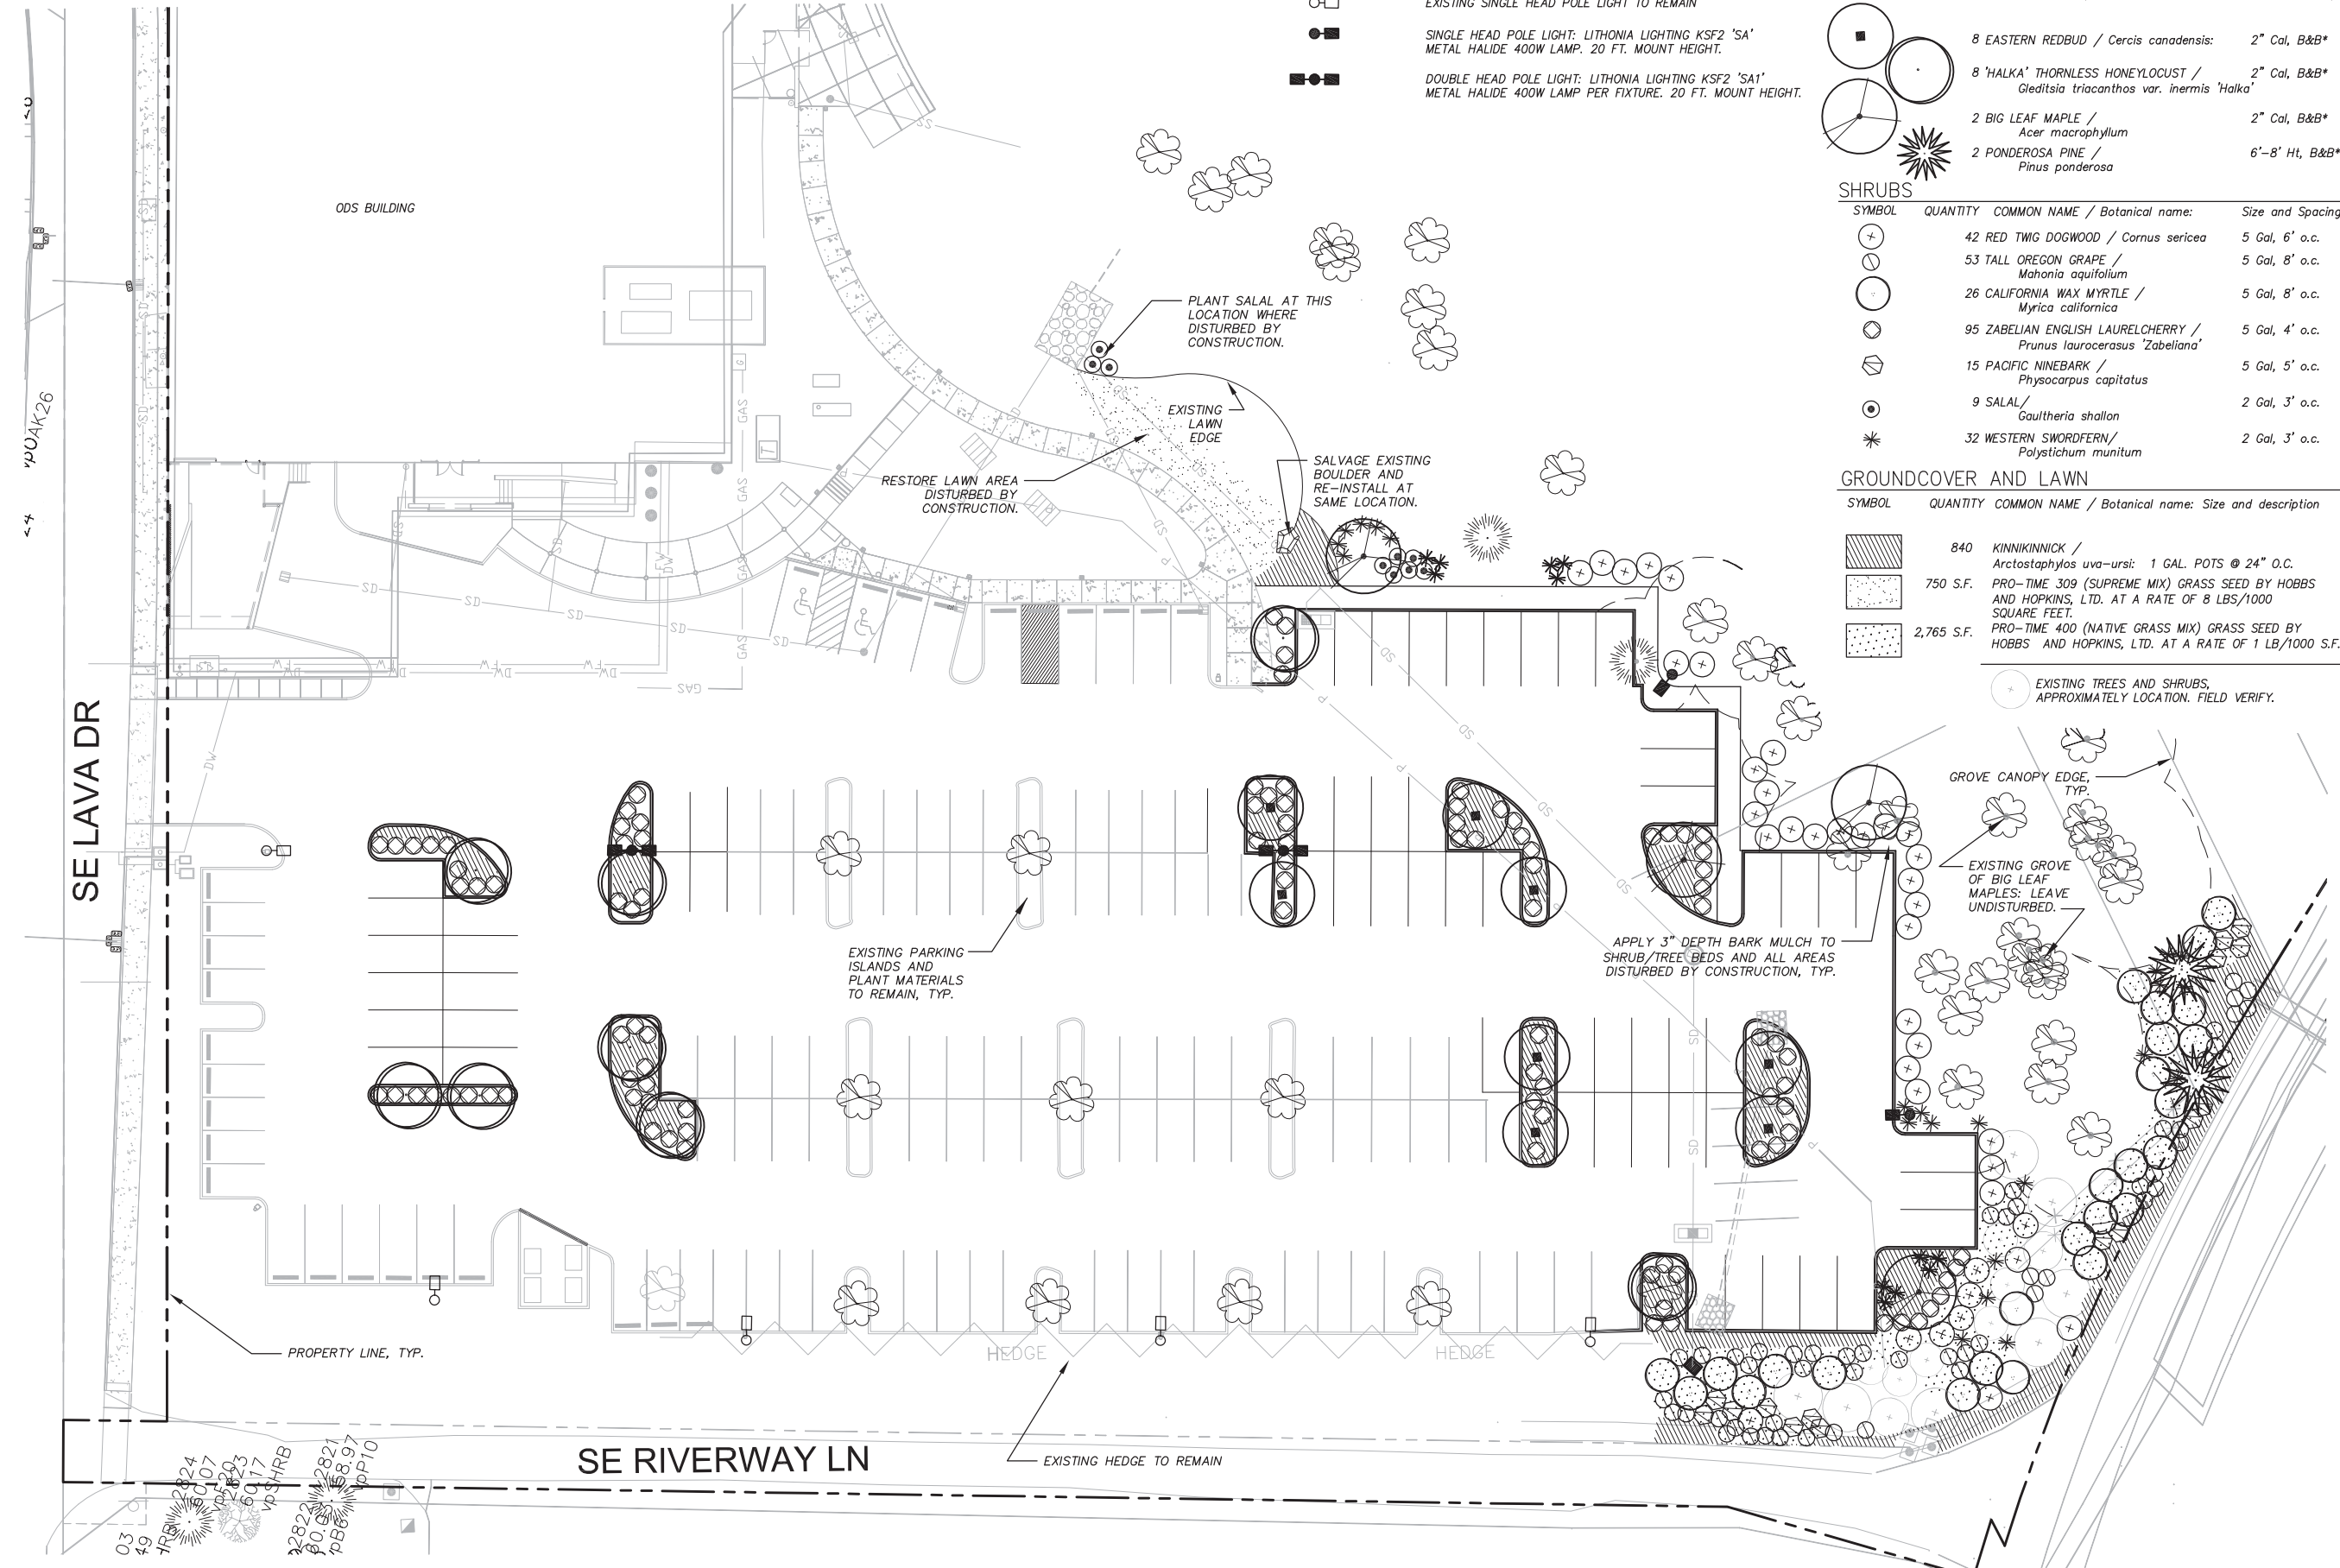

NO.	DATE	BY	REVISION COMMENTS


REGISTERED
 263
 DAVID D. HAYNES
 OREGON
 LANDSCAPE ARCHITECT

LAND USE RESUBMITTAL - APRIL 25, 2014

MODA PLAZA PARKING
 CITY OF MILWAUKIE, OREGON
 LANDSCAPE PLAN

otak
 HanniGood Partner
 808 SW 3rd Ave., Ste. 300
 Portland, OR 97204
 Phone: (503) 287-6825
 Fax: (503) 415-2304
 www.otak.com

17134 P17134P1.2
 Project No. Drawing No.
L1.0
 Sheet No.
 © Otak, Inc. 2014

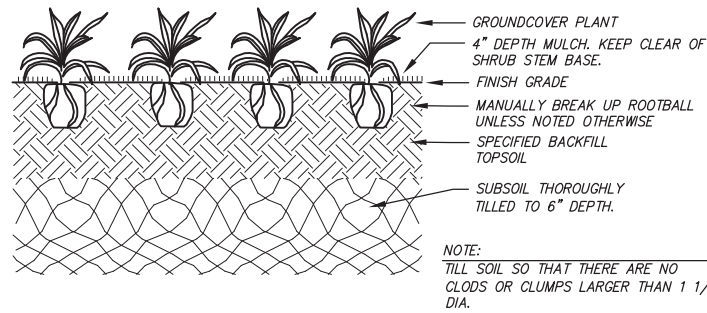


NOTE:
TILL SOIL SO THAT THERE ARE NO
CLODS OR CLUMPS LARGER THAN 1 1/2\"/>

GROUNDCOVER PLANTING DETAIL

5

L1.1

SCALE: N.T.S.

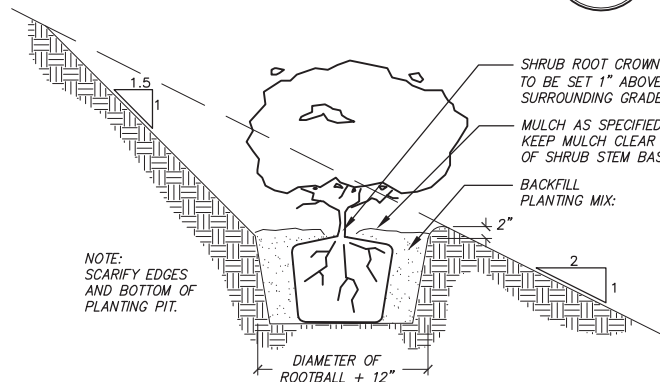


NOTE:
SCARIFY EDGES
AND BOTTOM OF
PLANTING PIT.

TREE/SHRUB PLANTING ON SLOPE

4

L1.1

SCALE: N.T.S.

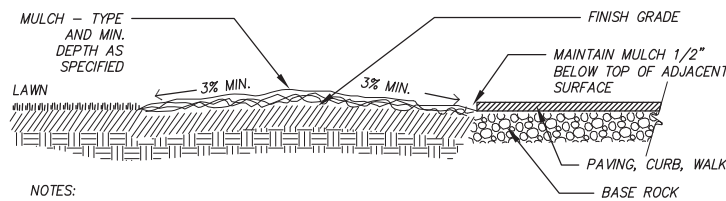


NOTES:
1. THE MINIMUM SLOPE FOR PLANTING AREAS IS 3%.

SECTION - PLANTING BED GRADING

3

L1.1

SCALE: N.T.S.

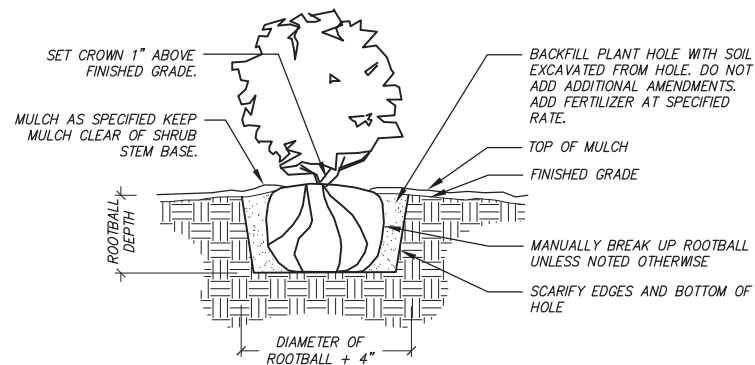

SHRUB PLANTING DETAIL

2

L1.1


SCALE: N.T.S.

UTILITY NOTE:

CONTRACTOR IS CAUTIONED THAT EXISTING UNDERGROUND FACILITIES OCCUR THROUGHOUT THE WORK AREAS INCLUDING BUT NOT LIMITED TO POWER, GAS, TELEPHONE, WATER SUPPLY, AND IRRIGATION. CONTRACTOR SHALL MARK THE FACILITIES BEFORE WORK, POTHOLE WHERE NECESSARY, AND PROTECT DURING CONSTRUCTION. IMMEDIATELY NOTIFY OWNER'S REPRESENTATIVE IF ANY CONFLICTS ARE FOUND.

LANDSCAPE NOTES:

- GENERAL: SEVERAL OF THE FOLLOWING NOTES SUMMARIZE THE PROJECT SPECIFICATIONS FOR THE CONTRACTORS CONVENIENCE. IF A DISCREPANCY EXISTS BETWEEN THESE NOTES AND THE PROJECT SPECIFICATIONS THE SPECIFICATIONS SHALL OVERRIDE.
- THE LANDSCAPE CONTRACTOR IS TO THOROUGHLY REVIEW THE SITE. IF THERE ARE ANY DISCREPANCIES BETWEEN THE PLAN AND THE EXISTING CONDITIONS THE OWNERS REPRESENTATIVE IS TO BE NOTIFIED IMMEDIATELY.
- IF THE LANDSCAPE CONTRACTOR STARTS WORK BEFORE SITE CONDITIONS ARE READY OR CONTINUES WORK IN ADVERSE CONDITIONS WITHOUT PRIOR APPROVAL THEY WILL BE RESPONSIBLE FOR ANY ADDITIONAL COSTS RELATING TO THE CONDITION.
- IMMEDIATELY NOTIFY OWNERS REPRESENTATIVE CONCERNING ANY CONDITION AT ANY TIME DURING CONSTRUCTION THAT IS DETRIMENTAL TO THE HEALTH AND VIGOROUS GROWTH OF THE SPECIFIED PLANT MATERIAL.
- PROVIDE QUANTITY OF PLANT MATERIAL INDICATED IN PLANT LIST OR THE QUANTITY REQUIRED TO COVER AREAS INDICATED AT SPECIFIED SPACING, WHICHEVER IS GREATER.
- IF AN AREA DIFFERS SIGNIFICANTLY IN SIZE FROM THAT SCALED ON DRAWING AND REQUIRES MORE OR LESS MATERIAL THE OWNERS REPRESENTATIVE IS TO BE INFORMED.
- TOPSOIL: 8" DEPTH IMPORT TOPSOIL SHALL BE PREPARED AND AMENDED IN ACCORDANCE WITH THE DETAILS AND SPECIFICATIONS.
- SOIL ANALYSIS: CONTRACTOR SHALL OBTAIN A COPY OF OWNER-PROVIDED SOIL TEST AND AMEND AND FERTILIZE IN CONFORMANCE WITH RECOMMENDATIONS INDICATED IN THE REPORT.
- COMPOST: APPLY 3 INCH DEPTH SPECIFIED COMPOST OVER ALL PLANTING AREAS. TILL IN TO IMPORT TOPSOIL TO A DEPTH OF 6 INCHES.
- FERTILIZER: APPLY FERTILIZER TO ALL PLANT HOLES AND TURF AREAS OF THE TYPE, QUANTITY, APPLICATION METHOD, AND TIMING NOTED IN THE SPECIFICATIONS.
- BARK MULCH: SPREAD 3 INCH DEPTH FINE-MEDIUM GRADE FIR/HEMLOCK BARK OVER ALL SHRUB BEDS. KEEP BARK CLEAR OF TREE AND SHRUB STEM BASE.
- PLANTING POCKETS: BACK FILL PLANT HOLE WITH AMENDED SOIL EXCAVATED FROM HOLE. DO NOT ADD ADDITIONAL AMENDMENTS.
- PLANT MATERIAL: ALL PLANT MATERIAL SHALL MEET MINIMUM QUALITY AND SIZE REQUIREMENTS ESTABLISHED IN THE AMERICAN STANDARD FOR NURSERY STOCK GUIDELINES.
- LEAVE PLANT NAME IDENTIFICATION TAGS ON TEN PERCENT OF ALL TREES AND SHRUBS INSTALLED TO AID INSPECTORS IN VERIFYING THAT SPECIFIED PLANTS HAVE BEEN INSTALLED.
- PLANT CENTER OF SHRUBS A MINIMUM OF 24 INCHES FROM ADJACENT PAVING. PLANT CENTER OF GROUND COVERS A MINIMUM OF 18 INCHES FROM ADJACENT PAVING.
- WHERE PLANT BED SLOPE IS LESS THAN 3% MOUND PLANTING BED AREAS 3% MINIMUM FOR POSITIVE DRAINAGE.
- SEE SPECIFICATIONS FOR FINAL INSPECTION, MAINTENANCE, AND WARRANTY REQUIREMENTS UNIQUE TO THIS PROJECT.
- SEE SPECIFICATIONS FOR OTHER LANDSCAPE CONSTRUCTION REQUIREMENTS.

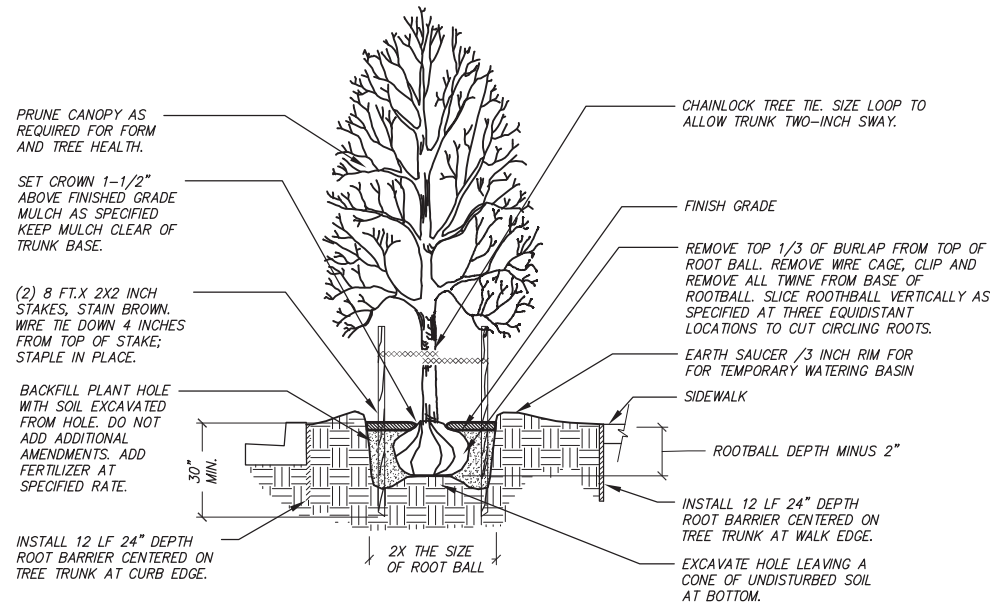


TREE PLANTING WITH ROOT BARRIER

7

L1.1

SCALE: N.T.S.

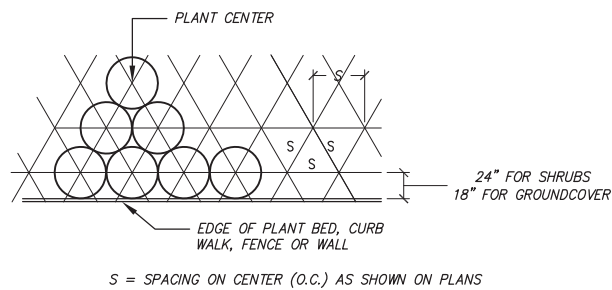


PLANT SPACING

6

L1.1

SCALE: N.T.S.

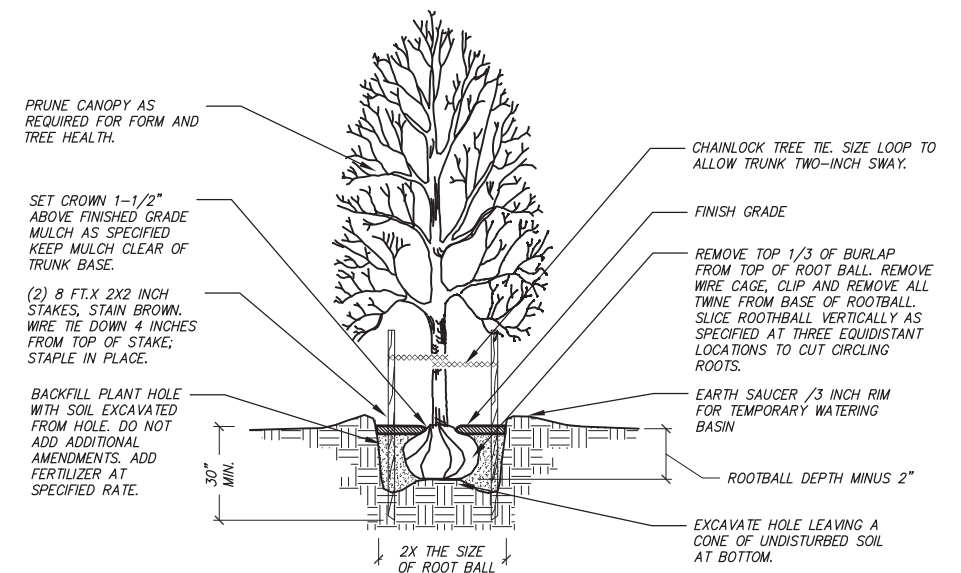

TREE PLANTING DETAIL

1

L1.1

SCALE: N.T.S.

LAND USE RESUBMITAL - APRIL 25, 2014

MODA PLAZA PARKING
CITY OF MILWAUKIE, OREGON

PLANTING NOTES AND DETAILS

otak
HammiGood Partner
808 SW 3rd Ave., Ste. 300
Portland, OR 97204
Phone: (503) 287-6825
Fax: (503) 415-2304
www.otak.com

17134 P17134L-SERIES
Project No. Drawing No.

L1.1

Sheet No.
© Otak, Inc. 2014

REGISTERED
PREMIER
DAVID HAYNES
ORLANDSON
LANDSCAPE ARCHITECT

NO.	DATE	BY	REVISION COMMENTS	Design	Drawn	Checked	Date	Initial Issue Date:
				DDH	MLD	MAP		